Assessment and Repair - Integrity Assessment Via Pressure Test

1. Test Acceptance Criteria and Procedures Were test acceptance criteria and procedures/processes sufficient to assure the basis for an acceptable pressure test? (AR.PTI.PRESSTESTACCEP.P) 192.503(a) (192.503(b);192.503(c);192.503(d);192.503(e);192.505(a);192.505(b);192.505(c);192.505(d);192.507(a);192.507(b);192.507 (c);192.513(a);192.513(b);192.513(d))

Assessment and Repair - Repair Criteria (O and M)

- **1. Repair of Corroded Pipe** Does the process give sufficient guidance for personnel to repair or replace pipe that has corroded to an extent that there is no longer sufficient remaining strength in the pipe wall? (AR.RCOM.REPAIR.P) 192.605(b)(2) (192.487(a);192.489(a);192.489(b);192.491(c))
- **2. Repair of Corroded Pipe** Do records document the repair or replacement of pipe that has been internally corroded to an extent that there is not sufficient remaining strength in the pipe wall? (AR.RCOM.REPAIR.R) 192.491(c) (192.487;192.489)
- **3. Field Inspection Remedial Actions (OM)** *Is anomaly remediation and documentation of remediation adequate for all segments?* (AR.RCOM.REMEDIATIONOM.O) 192.487(a) (192.487(b);192.489)
- **4. Plastic Leak Repair Mechanical Clamps** Does the operator's process ensure that mechanical leak clamps are not used as a permanent repair method for plastic pipe? (AR.RCOM.PLASTICLEAKCLAMP.P) 192.720

 Note: this question is presented in multiple places so you will see multiple instances of it on this report.
- **5. Plastic Leak Repair Mechanical Clamps** Do records indicate that mechanical leak clamp repairs for plastic pipe are documented with date installed, location, and date of removal? (AR.RCOM.PLASTICLEAKCLAMP.R) 192.720

 Note: this question is presented in multiple places so you will see multiple instances of it on this report.
- **6. Plastic Leak Repair Mechanical Clamps** *Do field observations verify that mechanical leak clamp repairs for plastic pipe were installed and documented properly?* (AR.RCOM.PLASTICLEAKCLAMP.O) 192.720 (192.605;192.603) **Note: this question is presented in multiple places so you will see multiple instances of it on this report.**

GD.2024.01 Page 1 of 85

Assessment and Repair - Repair Methods and Practices

1. Safety While Making Repairs Does the process ensure that repairs are made in a safe manner and are made so as to prevent damage to persons and property? (AR.RMP.SAFETY.P) 192.605(b)(9) (192.713(b))
2. Prevention of Accidental Ignition <i>Perform observations of selected locations to verify that adequate steps have been taken by the operator to minimize the potential for accidental ignition.</i> (AR.RMP.IGNITION.O) 192.751(a) (192.751(b);192.751(c))
3. Tapping Pipelines Under Pressure <i>Is the process adequate for tapping pipelines under pressure?</i> (AR.RMP.HOTTAP.P) 192.605(b)(1) (192.627)
4. Test Reinstated Service Lines <i>Is the process adequate for the testing of disconnected service lines?</i> (AR.RMP.TESTREINSTATE.P) 192.605(b) (192.725(a);192.725(b))
5. Test Reinstated Service Lines From the review of records, did the operator properly test disconnected service lines? (AR.RMP.TESTREINSTATE.R) 192.603(b) (192.725(a);192.725(b))
CRM, SCADA, and Leak Detection - General
1. Control Room Management Criteria Do procedures adequately address the process and criteria to determine which facilities are control rooms? (CR.CRMGEN.CRMCRITERIA.P) 192.631(a)(2)
2. Control Room Management Are CRM procedures formalized and controlled? (CR.CRMGEN.CRMMGMT.P) 192.631(a)(2)

3. Control Room Management Were procedures approved, in place, and implemented on or before the regulatory deadline? (CR.CRMGEN.CRMIMPLEMENT.R) 192.631(a)(2)

GD.2024.01 Page 2 of 85

4. Control Room Management	Are procedures readily available to controllers in the control room?
(CR.CRMGEN.CRMPROCLOCATION.O) 192	.631(a)(2)

CRM, SCADA, and Leak Detection - Roles and Responsibilities

1. Roles and Responsibilities Are there clear processes to descri	ribe each controller's physical domain of responsibility
for pipelines and other facility assets? (CR.CRMRR.RESPONSIBLE.P) 192.6	531(b)

- **2. Roles and Responsibilities** Are there provisions in place to assure that only qualified individuals may assume control at any console/desk? (CR.CRMRR.QUALCONTROL.P) 192.631(b)
- **3. Roles and Responsibilities** If the physical domain of responsibility periodically changes, has a clear process been established to describe the conditions for when such a change occurs? (CR.CRMRR.DOMAINCHANGE.P) 192.631(b)
- **4. Controller Authority (Abnormal Operations)** Have processes been established to define the controllers' authority and responsibilities when an abnormal operating condition is detected? (CR.CRMRR.AUTHORITYABNORMAL.P) 192.631(b)(2)
- **5. Roles and Responsibilities** *Do processes address a controller's role during temporary impromptu (unplanned) changes in controller responsibilities?* (CR.CRMRR.RESPCHANGE.P) 192.631(b)
- **6. Roles and Responsibilities** Do the defined roles and responsibilities require controllers to stay at the console to verify all SCADA commands that have been initiated are fulfilled, and that commands given via verbal communications are acknowledged before leaving the console for any reason? (CR.CRMRR.COMMANDVERIFY.P) 192.631(b)
- **7. Overpressure Limits** Are controllers aware of the current MAOPs of all pipeline segments for which they are responsible, and have they been assigned the responsibility to maintain those pipelines at or below the MAOP? (CR.CRMRR.PRESSLIMITS.O) 192.631(b)(2) (192.619(a);192.631(e)(1))

GD.2024.01 Page 3 of 85

8. Controller Authority (Emergency Operations) Do processes define the controllers' authority and responsibility to make decisions, take actions, and communicate with others upon being notified of, or upon detection of, and during, an emergency or if a leak or rupture is suspected? (CR.CRMRR.AUTHORITYEMERGENCY.P) 192.631(b)(3) (192.615(a)(8);NTSB P-11-9)
9. Control Center Evacuation Do processes specifically address the controller's responsibilities in the event the control room must be evacuated? (CR.CRMRR.EVACUATION.P) 192.631(b)(3)
10. Communication Failure Do processes specifically address the controller's responsibilities in the event of a SCADA system or data communications system failure impacting large sections of the controller's domain of responsibility? (CR.CRMRR.COMMSYSFAIL.P) 192.631(b)(3)
11. Shift Change Process Have processes been established for the hand-over of responsibility that specify the type of information to be communicated to the oncoming shift? (CR.CRMRR.HANDOVER.P) 192.631(b)(4) (192.631(c)(5))
12. Shift Change Process Do observations indicate adequate hand-over of responsibility to the oncoming shift? (CR.CRMRR.HANDOVER.O) 192.631(b)(4) (192.631(c)(5))
13. Shift Change Process - Documentation Do processes require that records document the hand-over of responsibility, document the time the actual hand-over of responsibility occurs, and the key information and topics that were communicated during the hand-over? (CR.CRMRR.HANDOVERDOC.P) 192.631(b)(4) (192.631(c)(5))
14. Shift Change Process - Documentation Are there records that document the hand-over of responsibility, document the time the actual hand-over of responsibility occurs, and the key information and topics that were communicated during the hand-over? (CR.CRMRR.HANDOVERDOC.R) 192.631(b)(4) (192.631(c)(5))
15. Shift Change Process - Overlap Do processes require the controllers to discuss recent and impending important activities ensuring adequate overlap? (CR.CRMRR.HANDOVEROVERLAP.P) 192.631(b)(4)
16. Shift Change Process - Handover Alternative When a controller is unable to continue or assume responsibility for any reason, do the shift hand-over processes include alternative shift hand-over actions that specifically address this situation? (CR.CRMRR.HANDOVERALTERNATIVE.P) 192.631(b)(4)

GD.2024.01 Page 4 of 85

17. Shift Change Process - Unattended Consoles Has the operator established an adequate process for occasions when the console is left temporarily unattended for any reason? (CR.CRMRR.UNATTENDCONSOLE.P) 192.631(b)(4)
18. Shift Change Process - Console Coverage Do processes maintain adequate console coverage during shift hand-over? (CR.CRMRR.CONSOLECOVERAGE.P) 192.631(b)(4)
19. Authority to Supersede Controller Action Disallowed - Controllers <i>Do processes disallow others to have authority to direct or supersede the specific technical actions of a controller?</i> (CR.CRMRR.OTHERAUTHORITYDISALLOW.P) 192.631(b)(5)
20. Authority to Supersede Controller Action Disallowed - Controllers Do records indicate that the policy disallowing others to have authority to direct or supersede the specific technical actions of a controller has been communicated to controllers and others? (CR.CRMRR.OTHERAUTHORITYDISALLOW.R) 192.631(b)(5)
21. Authority to Supersede Controller Action Disallowed - Controllers Are controllers aware of, and car reference, processes that disallow others to have authority to direct or supersede the specific technical actions of a controller? (CR.CRMRR.OTHERAUTHORITYDISALLOW.O) 192.631(b)(5)
22. Others with Authority Qualification - Controllers Does the process result in identification of required qualification elements for those authorized to direct or supersede the technical actions of a controller that are sufficient for those individuals to understand the implications of the scope of potential actions? (CR.CRMRR.OTHERAUTHORITYQUAL.P) 192.631(b)(5)
23. Others with Authority Qualification - Controllers <i>Do records indicate that others given authority to direct or supersede the specific technical actions of a controller were qualified?</i> (CR.CRMRR.OTHERAUTHORITYQUAL.R) 192.631(b)(5)
24. Others with Authority Implementation - Controllers <i>Is the process defined with respect to the details of how those authorized to direct or supersede the technical actions of a controller are to implement their authority?</i> (CR.CRMRR.OTHERAUTHORITYIMPLEMENT.P) 192.631(b)(5)

25. Others with Authority List - Controllers *Is a list of individuals with authority to direct or supersede the technical actions of a controller readily available to controllers?* (CR.CRMRR.OTHERAUTHORITYLIST.R) 192.631(b)(5)

GD.2024.01 Page 5 of 85

26. Others with Authority Implementation - Controllers Do records adequately document occurrences of
when others authorized to direct or supersede the technical actions of a controller have done so?
(CR.CRMRR.OTHERAUTHORITYIMPLEMENT.R) 192.631(b)(5)

27. Otl	hers with	ı Author	ity Implei	mentation	- Controll	ers Do o	thers authoriz	ed to direct o	r supersede the
technical	l actions of a	controller	demonstrate	an understand	ding of the pro	cess to in	nplement this	authority?	
(CR.CRM	IRR.OTHERA	JTHORITYI	MPLEMENT.O) 192.631(b)(5)				

CRM, SCADA, and Leak Detection - Supervisory Control and Data Acquisition

1. Adequate Information (API 1165 Compliance) Do processes clearly define the types of changes to the
SCADA system(s) that constitute additions, expansions, or replacements under the meaning of the CRM rule?
(CR.SCADA.SYSTEMMOC.P) 192.631(c)(1)

- **2. SCADA Displays** Are there written processes to implement the API RP 1165 display standards to the SCADA systems that have been added, expanded, or replaced since August 1, 2012? (CR.SCADA.DISPLAYCONFIG.P) 192.631(c)(1)
- **3. SCADA API RP 1165 Human Factors** Has section 4 of API RP 1165 regarding human factors engineering been implemented? (CR.SCADA.1165HUMANFACTORS.O) 192.631(c)(1)
- **4. SCADA Display Objects** Has section 8 of API RP 1165 regarding display object characteristics been implemented? (CR.SCADA.DISPLAYOBJECTS.O) 192.631(c)(1)
- **5. SCADA Display Dynamics** Has Section 9 of API RP 1165 regarding display object dynamics been implemented? (CR.SCADA.DISPLAYDYNAMICS.R) 192.631(c)(1)
- **6. SCADA Administration** Have applicable paragraphs of section 11 of API RP 1165 administration been implemented? (CR.SCADA.ADMINISTRATION.R) 192.631(c)(1)

GD.2024.01 Page 6 of 85

7. SCADA Impracticality If any/all applicable paragraph(s) of API RP 1165 have not been implemented, has it been demonstrated and documented that the unimplemented provisions are impractical for the SCADA system used? (CR.SCADA.1165IMPRACTICAL.R) 192.631(c)(1)
8. Set Points Does the process adequately define safety-related points? (CR.SCADA.SETPOINT.P) 192.631(c)(2)
9. Set Points Do records indicate safety-related points have been adequately implemented? (CR.SCADA.SETPOINT.R) 192.631(c)(2)
10. Point-to-Point Verification Are there adequate processes to define and identify the circumstances which require a point-to-point verification? (CR.SCADA.POINTVERIFY.P) 192.631(c)(2)
11. Point-to-Point Verification Have required point-to-point verifications been performed? (CR.SCADA.POINTVERIFY.R) 192.631(c)(2)
12. Point-to-Point Verification Extent Are there adequate processes for the thoroughness of the point-to-point verification? (CR.SCADA.POINTVERIFYEXTENT.P) 192.631(c)(2)
13. Point-to-Point Verification Extent <i>Do records demonstrate adequate thoroughness of the point-to-point verification?</i> (CR.SCADA.POINTVERIFYEXTENT.R) 192.631(c)(2)
14. Point-to-Point Verification Interval <i>Is there an adequate process for defining when the point-to-point verification must be completed?</i> (CR.SCADA.POINTVERFIYINTVL.P) 192.631(c)(2)
15. Point-to-Point Verification Interval Do records indicate the point-to-point verification has been completed at the required intervals? (CR.SCADA.POINTVERFIYINTVL.R) 192.631(c)(2)

GD.2024.01 Page 7 of 85

16. Point-to-Point Verification Are point-to-point verifications performed adequately when required? (CR.SCADA.POINTVERIFY.O) 192.631(c)(2)
17. Internal Communication Plan Has an internal communication plan been established and implemented that is adequate to manually operate the pipeline during a SCADA failure/outage? (CR.SCADA.COMMPLAN.P) 192.631(c)(3)
18. Internal Communication Plan Has the internal communication plan been tested and verified for manual operation of the pipeline safely at least once each calendar year but at intervals not exceeding 15 months? (CR.SCADA.COMMPLAN.R) 192.631(c)(3)
19. Backup SCADA System Is there a backup SCADA system? (CR.SCADA.BACKUPSCADA.O) 192.631(c)
20. Backup SCADA Development Has the use of the backup SCADA system for development work been defined? (CR.SCADA.BACKUPSCADADEV.P) 192.631(c)(4)
21. Backup SCADA Testing <i>Is the backup SCADA system required to be tested at least once each calendar year at intervals not to exceed 15 months?</i> (CR.SCADA.BACKUPSCADATEST.P) 192.631(c)(4)
22. Backup SCADA Testing <i>Is the backup SCADA system tested at least once each calendar year at intervals not to exceed 15 months?</i> (CR.SCADA.BACKUPSCADATEST.R) 192.631(c)(4)
23. Backup SCADA Verification <i>Is testing required to verify adequate processes are in place for decision-making and internal communications to successfully implement a transition from primary SCADA to backup SCADA, and back to primary SCADA?</i> (CR.SCADA.BACKUPSCADAVERIFY.P) 192.631(c)(4)
24. Backup SCADA Verification Does the testing verify that there are adequate processes in place for decision-making and internal communications to successfully implement a transition from primary SCADA to backup SCADA, and back to primary SCADA? (CR.SCADA.BACKUPSCADAVERIFY.R) 192.631(c)(4)

GD.2024.01 Page 8 of 85

25. Backup SCADA Adequacy If the back-up SCADA system is not designed to handle all the functionality of the main SCADA system, does the testing determine whether there are adequate procedures in place to account for displaced and/or different available functions during back-up operations? (CR.SCADA.BACKUPSCADAADEQUACY.R) 192.631(c)(4)
26. Backup SCADA Transfer Do processes adequately address and test the logistics of transferring control to a backup control room? (CR.SCADA.BACKUPSCADATRANSFER.P) 192.631(c)(4)
27. Backup SCADA Return to Primary <i>Do procedures adequately address and test the logistics of returning operations back to the primary control room?</i> (CR.SCADA.BACKUPSCADARETURN.P) 192.631(c)(4)
28. Backup SCADA Testing <i>Is a representative sampling of critical functions in the back-up SCADA system being tested to ensure proper operation in the event the backup system is needed?</i> (CR.SCADA.BACKUPSCADAFUNCTIONS.R) 192.631(c)(4)
CRM, SCADA, and Leak Detection - Fatigue Management
1. Fatigue Mitigation Does the fatigue mitigation process or procedures (plan) identify operator-specific fatigue risks? (CR.CRMFM.FATIGUEMITIGATION.P) 192.631(d) (192.631(a))
2. Fatigue Risk Reduction Does the fatigue mitigation plan adequately address how the program reduces the risk associated with controller fatigue? (CR.CRMFM.FATIGUERISKS.P) 192.631(d) (192.631(a))
3. Fatigue Quantification Do processes require that the potential contribution of controller fatigue to incidents and accidents be quantified during investigations? (CR.CRMFM.FATIGUEQUANTIFY.P) 192.631(d) (192.631(a);192.631(g)(1))
4. Fatigue Mitigation Manager <i>Is there a designated fatigue risk manager who is responsible and accountable for managing fatigue risk and fatigue countermeasures, and someone (perhaps the same person) that is authorized to review and approve HOS emergency deviations?</i> (CR.CRMFM.FATIGUEMANAGER.P) 192.631(d) (192.631(a))

GD.2024.01 Page 9 of 85

5. Scheduled Shift Length <i>Is the scheduled shift length less than or equal to 12 hours (not including shift hand-over) or is there a documented technical basis to show that shift lengths and schedule rotations are adequate to provide controllers off-duty time sufficient to achieve 8 hours of continuous sleep?</i> (CR.CRMFM.SHIFTLENGTH.R) 192.631(d)(1) (192.631(a))
6. Establishing Shift Length Does the operator factor in all time the individual is working for the company when establishing shift lengths and schedule rotations and that periods of time off that accommodates commute time or is there a documented technical basis to show that shift lengths and schedule rotations are adequate to provide controllers off-duty time sufficient to achieve 8 hours of continuous sleep? (CR.CRMFM.SHIFTLENGTHTIME.R) 192.631(d)(1)
7. Scheduled Time Off Between Shifts Are all scheduled periods of time off at least one hour longer than 8 hours plus commute time or is there a documented technical basis to show that shift lengths and schedule rotations are adequate to provide controllers off-duty time sufficient to achieve 8 hours of continuous sleep? (CR.CRMFM.SCHEDULEDTIMEOFF.R) 192.631(d)(1)
8. On Call Controllers For controllers who are on call, do processes minimize interrupting the required 8 hours of continuous sleep or require a documented technical basis to show that shift lengths and schedule rotations are adequate to provide controllers off-duty time sufficient to achieve 8 hours of continuous sleep? (CR.CRMFM.ONCALLCONTROLLER.P) 192.631(d) (192.631(a))
9. On Call Controllers Do records for controllers on call, provide records shift schedule, when calls were made for on call and how long the individual worked? (CR.CRMFM.ONCALLCONTROLLER.R) 192.631(d)(1)
10. Maximum Hours of Service Do processes limit the maximum HOS limit in any sliding 7-day period to no more than 65 hours or is there a documented technical basis to show a reduction of the risk associated with controller fatigue? (CR.CRMFM.MAXHOS.P) 192.631(d)(4)
11. Documented Time Schedule <i>Is there a formal system to document all scheduled and unscheduled HOS worked, including overtime and time spent performing duties other than control room duties?</i> (CR.CRMFM.DOCSCHEDULE.P) 192.631(d)(4) (192.631(a))
12. Time Off Following Successive Days Worked For normal business hour type operations (i.e., five days per week), are no more than five days worked in succession before at least two days off? (CR.CRMFM.DAYSOFF.P) 192.631(d)(4)

(192.631(a))

GD.2024.01 Page 10 of 85

13. Day Only Work Hours For normal business hour type operations (i.e., five days per week), do records indicate shift start times no earlier than 6:00 a.m. and shift end times no later than 7:00 p.m.? (CR.CRMFM.WORKHOURS.R) 192.631(d)(4)
14. Number of Qualified Controllers <i>Do operations include a sufficient number of qualified controllers?</i> (CR.CRMFM.CONTROLLERNUMBERS.O) 192.631(d)
15. Off Duty Hours When Limits Reached Do processes ensure that controllers are provided with at least thirty-five (35) continuous off-duty hours when limits are reached following the most recent 35-hour (minimum) off-duty rest period or is there a documented technical basis to show that the maximum limit on controller HOS is adequate to reduce the risk associated with controller fatigue? (CR.CRMFM.OFFDUTYHOURS.P) 192.631(d)(4)
16. Shift Holdover Does the daily HOS limit and shift holdover process conform to shift HOS and holdover guidelines or is there a documented technical basis to show that the maximum limit on controller HOS is adequate to reduce the risk associated with controller fatigue? (CR.CRMFM.SHIFTHOLDOVER.P) 192.631(d)(4) (192.631(a))
17. Specific Fatigue Countermeasures During Times of Heightened Risk Do processes require specific fatigue countermeasures during applicable time periods, or is there a documented technical basis to show that the maximum limit on controller HOS is adequate to reduce the risk associated with controller fatigue? (CR.CRMFM.SPECIFICCOUNTERMEASURES.P) 192.631(d)(4) (192.631(a))
18. Deviations from HOS Limits <i>Is there a formal process for approving deviations from the maximum HOS limits?</i> (CR.CRMFM.HOSDEVIATIONS.P) 192.631(d)(4) (192.631(a))
19. Fatigue Education Does the program require that fatigue education/training is required for all controllers and control room supervisors? (CR.CRMFM.FATIGUEEDUCATE.P) 192.631(d)(2) (192.631(d)(3);192.631(a))
20. Review of Fatigue Education/Training Program Effectiveness Do processes require that the effectiveness of the fatigue education/training program be reviewed at least once each calendar year, not to exceed 15 months? (CR.CRMFM.FATIGUEREVIEW.P) 192.631(d)(2) (192.631(d)(3);192.605(a))
21. Fatigue Mitigation Strategies Does fatigue education address fatigue mitigation strategies (countermeasures), how off-duty activities contribute to fatigue and recognizing the effects of fatigue? (CR.CRMFM.FATIGUESTRATEGY.P) 192.631(d)(2) (192.631(a))

GD.2024.01 Page 11 of 85

22. Fatigue Education Is fatigue education/training documented for all controllers and control room supervisors? (CR.CRMFM.FATIGUEEDUCATE.R) 192.631(d)(2) (192.631(d)(3))
23. Fatigue Training Content <i>Is the content of fatigue training adequate for training controllers and supervisors to recognize the effects of fatigue?</i> (CR.CRMFM.FATIGUECONTENT.P) 192.631(d)(3)
24. Fatigue Training Content Has controller and supervisor training to recognize the effects of fatigue been documented? (CR.CRMFM.FATIGUECONTENT.R) 192.631(d)(3)
CRM, SCADA, and Leak Detection - Alarm Management
1. Alarm Procedures <i>Is the alarm management plan a formal process that specifically identifies critical topical areas included in the program?</i> (CR.CRMAM.ALARM.P) 192.631(e)
2. Alarm Malfunction <i>Is there a process to identify and correct inaccurate or malfunctioning alarms?</i> (CR.CRMAM.ALARMMALFUNCTION.P) 192.631(e)(1)
3. Alarm Review Does the review of safety-related alarms account for different alarm designs and all alarm types/priorities? (CR.CRMAM.ALARMREVIEW.P) 192.631(e)(1)
4. Controller SCADA Performance Does the review of safety-related alarms account for console differences that could affect individual-specific controller qualification and performance? (CR.CRMAM.CONTROLLERPERFORMANCE.P) 192.631(h) (192.631(e)(1))
5. Managing Stale or Unreliable Data Does the review of safety-related alarms include specific procedures and practices for managing stale or unreliable data? (CR.CRMAM.STALEDATA.P) 192.631(e)(1)

GD.2024.01 Page 12 of 85

6. Monthly Analysis of SCADA Data Do processes require the monthly identification, recording, review, and analysis of points that have been taken off scan, have had alarms inhibited, generated false alarms, or that have had forced or manual values for periods of time exceeding that required for associated maintenance or operating activities? (CR.CRMAM.MONTHLYANALYSIS.P) 192.631(e)(2)
7. Correction of SCADA Problems Does the alarm management plan include a process for promptly correcting identified problems and for returning these points to service? (CR.CRMAM.PROBLEMCORRECTION.P) 192.631(e)(2)
8. Alarm Point Verification Do records verify that monthly reviews and analysis of alarm points have been performed? (CR.CRMAM.ALARMVERIFY.R) 192.631(e)(2)
9. Alarm Setpoint Process <i>Is there a formal process to determine the correct alarm setpoint values and alarm descriptions?</i> (CR.CRMAM.ALARMSETPOINTS.P) 192.631(e)(3)
10. Controls on SCADA Settings Have procedures been established to clearly address how and to what degree controllers can change alarm limits or setpoints, or inhibit alarms, or take points off-scan? (CR.CRMAM.SETTINGCONTROL.P) 192.631(e)(3)
11. Alarm Value Verification Do records demonstrate verification of correct safety-related alarm set-point values and alarm descriptors when associated field instruments are calibrated or changed and at least once each calendar year, but at intervals not to exceed 15 months? (CR.CRMAM.ALARMVALUEVERIFY.R) 192.631(e)(3)
12. Alarm Management Plan Review Are there processes to review the alarm management plan at least once each calendar year, but at intervals not exceeding 15 months, in order to determine the effectiveness of the plan? (CR.CRMAM.PLANREVIEW.P) 192.631(e)(4)
13. Alarm Management Plan Review Do records indicate review of the alarm management plan at least once each calendar year, but at intervals not exceeding 15 months, in order to determine the effectiveness of the plan? (CR.CRMAM.PLANREVIEW.R) 192.631(e)(4)
14. Measuring Work Load Does the CRM program have a means of identifying and measuring the work load (content and volume of general activity) being directed to an individual controller? (CR.CRMAM.WORKLOAD.P) 192.631(e)(5)

GD.2024.01 Page 13 of 85

15. Monitoring Work Load <i>Is the process of monitoring and analyzing general activity comprehensive?</i> (CR.CRMAM.WORKLOADMONITORING.P) 192.631(e)(5)
16. Controller Reaction to Incoming Alarms Does the process have a means of determining that the controller has sufficient time to analyze and react to incoming alarms? (CR.CRMAM.CONTROLLERREACTION.P) 192.631(e)(5)
17. Analysis of Controller Performance Has an analysis been performed to determine if controller(s) performance is currently adequate? (CR.CRMAM.PERFORMANCEANALYSIS.R) 192.631(e)(5)
18. Alarm Deficiency Resolution <i>Is there a process to address how deficiencies found in implementing</i> 192.631(e)(1) through 192.631(e)(5) will be resolved? (CR.CRMAM.DEFICIENCIES.P) 192.631(e)(6)
19. Alarm Management Deficiencies Do records indicate deficiencies found in implementing 192.631(e)(1) through 192.631(e)(5) have been resolved? (CR.CRMAM.DEFICIENCIES.R) 192.631(e)(6)
CRM, SCADA, and Leak Detection - Change Management
1. Field Equipment Changes <i>Is there a process to assure changes in field equipment that could affect control room operations are coordinated with the control room personnel?</i> (CR.CRMCMGT.EQUIPMENTCHANGES.P) 192.631(f)(1)
2. Controller Participation in System Changes Are control room representative(s) required to participate in meetings where changes that could directly or indirectly affect the hydraulic performance or configuration of the pipeline (including routine maintenance and repairs) are being considered, designed and implemented? (CR.CRMCMGT.CONTROLLERPARTICIPATE.P) 192.631(f)(1) (192.631(f)(3))
3. Controller Participation in System Changes Do records indicate that control room representative(s) participate in meetings where changes that could directly or indirectly affect the hydraulic performance or configuration of the pipeline (including routine maintenance and repairs) are being considered, designed and implemented? (CR.CRMCMGT.CONTROLLERPARTICIPATE.R) 192.631(f)(1) (192.631(f)(3))

GD.2024.01 Page 14 of 85

4. Emergency Contact with Control Room <i>Is there a process requiring field personnel and SCADA support personnel to contact the control room when emergency conditions exist?</i> (CR.CRMCMGT.EMERGENCYCONTACT.P) 192.631(f)(2)
5. Coordination of Field Changes Does the process require field personnel and SCADA support personnel to contact the control room when making field changes (for example, moving a valve) that affect control room operations? (CR.CRMCMGT.FIELDCONTACT.P) 192.631(f)(2)
6. Coordination of Field Changes Do records indicate field personnel and SCADA support personnel contacted the control room when making field changes (for example, moving a valve) that affect control room operations? (CR.CRMCMGT.FIELDCHANGES.R) 192.631(f)(2)
CRM, SCADA, and Leak Detection - Operating Experience
1. Reportable Incident (Review) Is there a formal, structured approach for reviewing and critiquing reportable events to identify lessons learned? (CR.CRMEXP.REPORTABLEINCIDENTREVIEW.P) 192.631(g)(1)
2. Reportable Incident (Review) Do records indicate reviews of reportable events specifically analyzed all contributing factors to determine if control room actions contributed to the event, and corrected any deficiencies? (CR.CRMEXP.REPORTABLEINCIDENTREVIEW.R) 192.631(g)(1)
3. Lessons Learned Does the program require training on lessons learned from a broad range of events (reportable incidents/accidents, near misses, leaks, operational and maintenance errors, etc.), even though the control room may not have been at fault? (CR.CRMEXP.LESSONSLEARNED.P) 192.631(g)(2) (192.631(b)(5))
4. Lessons Learned Has operating experience review training been conducted on lessons learned from a broad range of events (reportable incidents/accidents, near misses, leaks, operational and maintenance errors, etc.)? (CR.CRMEXP.LESSONSLEARNED.R) 192.631(g)(2) (192.631(b)(5))

GD.2024.01 Page 15 of 85

CRM, SCADA, and Leak Detection - Training

1. Controller Training Program Has a controller training program been established to provide training for each controller to carry out their roles and responsibilities? (CR.CRMTRAIN.CONTROLLERTRAIN.P) 192.631(h)
2. Controller Training Program Has a controller training program been implemented to provide training for each controller to carry out their roles and responsibilities? (CR.CRMTRAIN.CONTROLLERTRAIN.R) 192.631(h)
3. Training Program Review Have processes been established to review the controller training program content to identify potential improvements at least once each calendar year, but at intervals not to exceed 15 months? (CR.CRMTRAIN.TRAININGREVIEW.P) 192.631(h)
4. Training Program Review Have processes been implemented to review the controller training program content to identify potential improvements at least once each calendar year, but at intervals not to exceed 15 months? (CR.CRMTRAIN.TRAININGREVIEW.R) 192.631(h)
5. Content of Training Program Does training content address all required material, including training each controller to carry out the roles and responsibilities that were defined by the operator? (CR.CRMTRAIN.TRAININGCONTENT.R) 192.631(h)
6. List of AOCs for Training Has training been conducted on the abnormal operating conditions (AOCs) that are likely to occur simultaneously or in sequence identified by the operator? (CR.CRMTRAIN.AOCLIST.R) 192.631(h)(1)
7. Controller Training and Qualification Does the training program provide controller training on recognizing and responding to abnormal operating conditions that are likely to occur simultaneously or in sequence? (CR.CRMTRAIN.TRAININGABNORMAL.P) 192.631(h)(1)
8. Controller Training and Qualification Do records indicate the training program used a simulator or tabletop exercises to train controllers how to recognize and respond to abnormal operating conditions? (CR.CRMTRAIN.TRAINING.R) 192.631(h)(2)

9. Controller Training and Qualification Does the training program use a simulator or tabletop exercises to train controllers how to recognize and respond to abnormal operating conditions? (CR.CRMTRAIN.TRAINING.O) 192.631(h)(2)

GD.2024.01 Page 16 of 85

10. Communication Training Does the CRM program train controllers on their responsibilities for communication under the operator's emergency response procedures? (CR.CRMTRAIN.COMMUNICATIONTRAINING.P) 192.631(h)(3)
11. Working Knowledge of Pipeline System Does the training program provide controllers a working knowledge of the pipeline system, especially during the development of abnormal operating conditions? (CR.CRMTRAIN.SYSKNOWLEDGE.P) 192.631(h)(4)
12. List of Infrequently Used Pipeline Setups Has a list of pipeline operating setups that are periodically (but infrequently) used been established? (CR.CRMTRAIN.INFREQOPSLIST.R) 192.631(h)(5)
13. Review of Procedures Prior to Use Do processes specify that, for pipeline operating set-ups that are periodically (but infrequently) used, the controllers must be provided an opportunity to review relevant procedures in advance of their use? (CR.CRMTRAIN.INFREQOPSREVIEW.P) 192.631(h)(5)
14. Control Room Team Training - Personnel <i>Do processes establish who, regardless of location, operationally collaborates with control room personnel?</i> (CR.CRMTRAIN.TEAMTRAINPERSONNEL.P) 192.631(h)(6)
15. Control Room Team Training - Frequency Do processes define the frequency of new and recurring team training? (CR.CRMTRAIN.TEAMTRAINFREQ.P) 192.631(h)(6)
16. Control Room Team Training - Completeness <i>Do processes address all operational modes and operational collaboration/control?</i> (CR.CRMTRAIN.TEAMTRAINCOMPLETE.P) 192.631(h)(6)
17. Control Room Team Training - Operational Experience Do processes include incorporation of lessons learned from actual historical events and other oil-gas industry events? (CR.CRMTRAIN.TEAMTRAINEXPERIENCE.P) 192.631(h)(6)
18. Control Room Team Training - Exercises Do records indicate that training exercises were adequate and involved at least one qualified controller? (CR.CRMTRAIN.TEAMTRAINEXERCISE.R) 192.631(h)(6)

GD.2024.01 Page 17 of 85

19. Control Room Team Training - Exercises Does implementation of a control room team exercise demonstrate performance in accordance with regulatory and process requirements? (CR.CRMTRAIN.TEAMTRAINEXERCISE.O) 192.631(h)(6)
20. Control Room Team Training - Identified Individuals Do records demonstrate that individuals identified as of January 23, 2018 received team training by January 23, 2019? (CR.CRMTRAIN.TEAMTRAINIDENTINDIVIDUAL.R) 192.631(h)(6)
CRM, SCADA, and Leak Detection - Compliance Validation and Deviations
1. Submittal of Procedures Are there adequate processes to assure that the operator is responsive to requests from applicable agencies to submit their CRM procedures? (CR.CRMCOMP.SUBMITPROCEDURES.P) 192.631(i)
2. Record of Procedure Submittals Has the operator been responsive to requests from applicable agencies to submit their CRM procedures? (CR.CRMCOMP.SUBMITPROCEDURES.R) 192.631(i)
3. CRM Coordinator <i>Is there an individual that is responsible and accountable for compliance with requests from PHMSA of other applicable agencies?</i> (CR.CRMCOMP.CRMCOORDINATOR.P) 192.631(i)
4. CRM Records Management Are records management processes adequate to assure records are sufficient to demonstrate compliance with the CRM rule? (CR.CRMCOMP.RECORDS.P) 192.631(j)(1)
5. CRM Records Are records sufficient to demonstrate compliance with the CRM rule? (CR.CRMCOMP.RECORDS.R) 192.631(j)(1)
6. Electronic Records Are electronic records properly stored, safeguarded, and readily retrievable? (CR.CRMCOMP.ELECTRONICRECORDS.R) 192.631(j)(1)

GD.2024.01 Page 18 of 85

7. CRM Deviations Are there processes to demonstrate and provide a documented record that every deviation from any CRM rule requirement was necessary for safe operation? (CR.CRMCOMP.DEVIATIONS.P) 192.631(j)(2)
8. Deviation Records Were all deviations documented in a way that demonstrates they were necessary for safe operation? (CR.CRMCOMP.DEVIATIONS.R) 192.631(j)(2)
Design and Construction - Construction
1. Joining of Materials Other than by Welding Does the process require that pipeline joints (to be made other than by welding) be designed and installed in accordance with 192.273? (DC.CO.NONWELDJOINT.P) 192.303 (192.273) Note: this question is presented in multiple places so you will see multiple instances of it on this report.
2. Underground Clearance Does the process require pipe to be installed with clearances specified in 192.325 and (if plastic) installed as to prevent heat damage to the pipe? (DC.CO.CLEARANCE.P) 192.303 (192.325(b);192.325(c)) Note: this question is presented in multiple places so you will see multiple instances of it on this report.
3. Underground Clearance Do records indicate that mains are installed with clearances specified in 192.325, and (if plastic) installed as to prevent heat damage to the pipe? (DC.CO.CLEARANCE.R) 192.325(b) (192.325(c)) Note: this question is presented in multiple places so you will see multiple instances of it on this report.
4. Underground Clearance Do field observations indicate that mains are installed with the clearances specified in 192.325 and (if plastic) installed as to prevent heat damage to the pipe? (DC.CO.CLEARANCE.O) 192.325(b) (192.325(c)) Note: this question is presented in multiple places so you will see multiple instances of it on this report.

GD.2024.01 Page 19 of 85

Design and Construction - Design of Pipe - Overpressure Protection

1.	Protection against Accidental Overpressuring Does the process require the pipeline have pressure relieving
or	pressure limiting devices that are required of 192.195(a), and that they meet the requirements of 192.199 and 192.201?
(D	C.DPCOPP.OVERPRESSURE.P) 192.303 (192.143(b);192.195(a);192.199;192.201(a);192.201(b);192.201(c);192.143(a))

	2. Protection against Accidental Overpressuring Do records indicate that the pipeline has pressure relieving or
ļ	pressure limiting devices that are required by 192.195(a), and that they meet the requirements of 192.199 and 192.201?
((DC.DPCOPP.OVERPRESSURE.R) 192.195(a) (192.199;192.201(a);192.201(b);192.201(c))

Design and Construction - Construction Weld Inspection

- **1. Inspection and Test of Welds** Does the process require visual inspections of welds to be conducted by qualified inspectors? (DC.WELDINSP.WELDVISUALQUAL.P) 192.303 (192.241(a);192.241(b);192.241(c))
- **2. Nondestructive Test and Interpretation Procedures** *Is there a process for welds nondestructive testing and interpretation in accordance with 192.243?* (DC.WELDINSP.WELDNDT.P) 192.243(a) (192.243(b);192.243(c);192.243(d);192.243(e))
- **3. Repair or Removal of Weld Defects** Does the process require welds that are unacceptable to be removed and/or repaired as specified by 192.245? (DC.WELDINSP.WELDREPAIR.P) 192.303 (192.245(a);192.245(b);192.245(c))

Design and Construction - Construction Welder Qualification

1. Limitations on Welders Does the process require certain limitations be placed on welders and welding operators in accordance with 192.229? (DC.WELDERQUAL.WELDERLIMITNDT.P) 192.303 (192.229(a);192.229(b);192.229(c);192.229(d))

GD.2024.01 Page 20 of 85

Design and Construction - Construction Welding Procedures

1. Welding Procedures Does the process require welding to be performed by qualified welders using qualified welding procedures and are welding procedures and qualifying tests required to be recorded in detail? (DC.WELDPROCEDURE.WELD.P) 192.225(a) (192.225(b))
2. Welding Procedures Do records indicate weld procedures are being qualified in accordance with 192.225? (DC.WELDPROCEDURE.WELD.R) 192.225(a) (192.225(b))
3. Welding Weather Does the process require welding to be protected from weather conditions that would impair the quality of the completed weld? (DC.WELDPROCEDURE.WELDWEATHER.P) 192.303 (192.231)
4. Miter joints Does the process prohibit the use of certain miter joints as required by 192.233? (DC.WELDPROCEDURE.MITERJOINT.P) 192.303 (192.233(a);192.233(b);192.233(c))
5. Preparation for Welding Does the process require certain preparations for welding, in accordance with 192.235? (DC.WELDPROCEDURE.WELDPREP.P) 192.303 (192.235)
Design and Construction - Design of Pipe Components
1. Flanges and Flange Accessories <i>Do records indicate flanges and flange accessories meet the requirements of 192.147?</i> (DC.DPC.FLANGE.R) 192.147(a) (192.147(b);192.147(c))
2. Flanges and Flange Accessories Do flanges and flange accessories meet the requirements of 192.147? (DC.DPC.FLANGE.O) 192.141 (192.147(a);192.147(b);192.147(c))
3. Distribution Valve Placement Are distribution line valves being installed as required of 192.181? (DC.DPC.GDVALVEPLACEMENT.O) 192.141 (192.181(a);192.181(b);192.181(c))

GD.2024.01 Page 21 of 85

Design and Construction - Maintenance and Operations

- **1. Start-Stop Procedures** During startup or shut-in, is it assured that the pressure limitations on the pipeline were not exceeded? (DC.MO.MAOPLIMIT.O) 192.605(b)(5)
- **2. Plastic Pipe Storage and Handling of Pipe and Components** *Does the operator have a written procedure for the storage and handling of plastic pipe and associated components?* (DC.PLASTIC.PLASTICHANDLING.P) 192.69 (192.59;192.63(e);192.321(g))

Note: this question is presented in multiple places so you will see multiple instances of it on this report.

3. Plastic Pipe - Storage and Handling of Pipe and Components *Do records indicate that the storage and handling of plastic pipe and associated plastic components were in accordance with noted procedures and applicable standards?* (DC.PLASTIC.PLASTICHANDLING.R) 192.69 (192.59;192.63(e);192.321(g))

Note: this question is presented in multiple places so you will see multiple instances of it on this report.

4. Plastic Pipe - Storage and Handling of Pipe and Components *Do field observations confirm plastic materials are stored and handled to ensure compliance with operator procedures?* (DC.PLASTIC.PLASTICHANDLING.O) 192.69 (192.59;192.63(e);192.65;192.67)

Note: this question is presented in multiple places so you will see multiple instances of it on this report.

Design and Construction - Materials

1. Marking of Materials Does the operator's specifications require pipe, valves, and fittings to be marked according to the requirements of §192.63? (DC.MA.MARKING.P) 192.63

Note: this question is presented in multiple places so you will see multiple instances of it on this report.

2. Marking of Materials Do records indicate that pipe, valves, and fittings were marked as required? (DC.MA.MARKING.R) 192.63

Note: this question is presented in multiple places so you will see multiple instances of it on this report.

GD.2024.01 Page 22 of 85

3. Marking of Mate	erials Are pipe, valves	, and fittings properly	marked for identificat	ion in accordance with the
requirements of 192.63?	(DC.MA.MARKING.O) 19	92.63(a) (192.63(b);1	192.63(c);192.63(d))	

Design and Construction - Meters, Service Regulators, and Service Lines

1. Customer Meters	and Regulator	Location Are mete	rs and serv	vice regulators being	g located cons	sistent with the
requirements of 192.353? (DC.METERREGSVC.C	USTMETERREGLOC.O)	192.351 ((192.353(a);192.35	3(b);192.353	(c);192.353(d))

- **2. Customer Meters and Regulator Protection** Are meters and service regulators being protected from damage consistent with the requirements of 192.355? (DC.METERREGSVC.CUSTMETERREGPROT.O) 192.351 (192.355(a);192.355(b);192.355(c))
- **3. Customer Meters and Regulator Installation** Based on the meters and service regulators observed being installed, are the installations consistent with the requirements of §192.357? (DC.METERREGSVC.CUSTMETERREGINSTALL.O) 192.351 (192.357(a);192.357(b);192.357(c);192.357(d))
- **4. Customer Meter Operating Pressure** Are customer meter operating pressures consistent with the requirements of 192.359? (DC.METERREGSVC.CUSTMETEROPPRESS.O) 192.351 (192.359(a);192.359(b);192.359(c))
- **5. Service Line Installation** Are customer service lines being installed consistent with the requirements of 192.361? (DC.METERREGSVC.SVCLINEINSTALL.O) 192.351 (192.361(a);192.361(b);192.361(c);192.361(e);192.361(f);192.361(g))
- **6. Service Line Valve and Location Requirements** Are customer service line valves being installed meeting the valve and locations requirements of 192.363 and 192.365? (DC.METERREGSVC.SVCLINEVLVLOCATEREQT.O) 192.351 (192.363(a);192.363(b);192.365(c);192.365(b);192.365(c))
- **7. Service Line Connection Requirements** Are customer service lines being installed with connections meeting the requirements of 192.367 and 192.369? (DC.METERREGSVC.SVCLINECONNECT.O) 192.351 (192.367(a);192.369(b);192.369(b))

GD.2024.01 Page 23 of 85

8. Service Line Connection Requirements Are customer service lines being installed constructed appropriately for
the types of materials used? (DC.METERREGSVC.SVCLINEMATERIAL.O) 192.351
(192.371;192.373(a);192.373(b);192.373(c);192.375(a);192.375(b);192.377)

- **9. Service Line Connection Requirements** Are new customer service lines not in use configured in accordance with the requirements of 192.379? (DC.METERREGSVC.NEWSVCLINENOTUSED.O) 192.351 (192.379;192.379(a);192.379(b);192.379(c))
- **10. Service Line Connection Requirements** Are service line excess flow valves located and identified in accordance with the requirements of 192.381? (DC.METERREGSVC.EXCSFLOWVLVLOCATE.O) 192.351 (192.381(c);192.381(d);192.381(e))

Design and Construction - Pressure Testing

1. Test Requirements for Service Lines *Do records indicate that pressure testing is conducted in accordance with* 192.511? (DC.PT.SERVICELINE.R) 192.517(b) (192.511(a);192.511(b);192.511(c))

Design and Construction - Pressure Testing - Low Pressure

- **1. Strength Test Duration Requirements for SMYS < 30%** Do records indicate that pressure testing is conducted in accordance with 192.507? (DC.PTLOWPRESS.PRESSTESTLOWSTRESS.R) 192.517(a) (192.507(a);192.507(b);192.507(c))
- **2. Strength Test Requirements for Operations < 100 psig** *Do records indicate that pressure testing is conducted in accordance with 192.509(a) (except for service lines and plastic pipelines)?* (DC.PTLOWPRESS.PRESSTEST100PSIG.R) 192.517(b) (192.509(a);192.509(b))

GD.2024.01 Page 24 of 85

Design and Construction - Plastic Pipe Construction

1. Design of Plastic Pipe (192.121) Does the process require the design pressure for plastic pipe to be determined in accordance with §192.121? (DC.PLASTIC.DESIGNPRESSPLASTIC.P) 192.121
2. Design of Plastic Pipe (192.121) Do design records and drawings indicate the design pressure for plastic pipe is determined in accordance with the formulas in §192.121? (DC.PLASTIC.DESIGNPRESSPLASTIC.R) 192.121
3. Plastic Pipe Specifications Does the operator's specifications require plastic pipe to meet the requirements of §192.53, §192.59, and other applicable requirements of this sub-part? (DC.PLASTIC.PLASTICSPECS.P) 192.53 (192.59)
4. Plastic Pipe Specifications Do records indicate that plastic pipe is qualified in accordance with §192.59? (DC.PLASTIC.PLASTICSPECS.R) 192.53 (192.59)
5. Plastic Pipe Specifications Do field observations confirm the plastic pipe meets the requirements of §192.53 and applicable requirements of this subpart? (DC.PLASTIC.PLASTICSPECS.O) 192.53 (192.59)
6. Design Pressure of Plastic Components / Fittings Does the process require plastic components and fittings are able to withstand operating pressures and other anticipated loads in accordance with a listed specification? (DC.PLASTIC.PLASTICFITTING.P) 192.143(c) (192.149(c))
7. Design Pressure of Plastic Components / Fittings Do records indicate that plastic components and fittings are able to withstand operating pressures and other anticipated loads in accordance with a listed specification? (DC.PLASTIC.PLASTICFITTING.R) 192.143(c) (192.149(c))

8. Marking of Materials Does the operator's specifications require pipe, valves, and fittings to be marked according to the

Note: this question is presented in multiple places so you will see multiple instances of it on

requirements of §192.63? (DC.MA.MARKING.P) 192.63

this report.

GD.2024.01 Page 25 of 85

9. Marking of Materials Do records indicate that pipe, valves, and fittings were marked as required? (DC.MA.MARKING.R) 192.63

Note: this question is presented in multiple places so you will see multiple instances of it on this report.

- 10. Joining of Materials Other than by Welding Does the process require that pipeline joints (to be made other than by welding) be designed and installed in accordance with 192.273? (DC.CO.NONWELDJOINT.P) 192.303 (192.273)

 Note: this question is presented in multiple places so you will see multiple instances of it on this report.
- **11. Plastic Pipe Joints** Does the process require plastic pipe joints to be designed and installed in accordance with 192.281? (DC.PLASTIC.PLASTICJOINT.P) 192.273(b) (192.281(a);192.281(b);192.281(c);192.281(d);192.281(e);192.303)
- **12. Plastic Pipe Joints** As applicable to the project, do records indicate that plastic pipe joints are installed in accordance with the requirements §192.281? (DC.PLASTIC.PLASTICJOINT.R) 192.281(a) (192.281(b);192.281(c);192.281(d);192.281(e))
- **13. Plastic Pipe Joints** *As applicable to the project, are plastic pipe joints installed in accordance with the requirements 192.281?* (DC.PLASTIC.PLASTICJOINT.O) 192.281
- **14. Plastic Pipe Qualifying Joining Procedures** Does the process require plastic pipe joining procedures to be qualified in accordance with §192.283, prior to making plastic pipe joints? (DC.PLASTIC.PLASTICJOINTPROCEDURE.P) 192.273(b) (192.283(a);192.283(b);192.283(c))
- **15. Plastic Pipe Qualifying Joining Procedures** Have plastic pipe joining procedures been qualified in accordance with 192.283? (DC.PLASTIC.PLASTICJOINTPROCEDURE.R) 192.273(b) (192.283(a);192.283(b);192.283(c))
- **16. Plastic Pipe Qualifying Personnel to Make Joints** *Is a process in place to ensure that personnel making joints in plastic pipelines are qualified?* (DC.PLASTIC.PLASTICJOINTQUAL.P) 192.285(d) (192.285(a);192.285(b);192.285(c);192.285(e);192.805)

GD.2024.01 Page 26 of 85

	17. Plastic Pipe - Qualifying Personnel to Make Joints Do records indicate persons making joints in plastic
ŀ	pipelines are qualified in accordance with §192.285? (DC.PLASTIC.PLASTICJOINTQUAL.R) 192.285(d)
((192.285(a);192.285(b);192.285(c);192.285(e);192.807(a);192.807(b))

- **18. Qualification of Personnel Inspecting Joints in Plastic Pipelines** *Is a process in place to assure that persons who inspect joints in plastic pipes are qualified?* (DC.PLASTIC.PLASTICJOINTINSP.P) 192.287 (192.805(h))
- **19. Qualification of Personnel Inspecting Joints in Plastic Pipelines** *Do records indicate persons inspecting the making of plastic pipe joints have been qualified?* (DC.PLASTIC.PLASTICJOINTINSP.R) 192.287 (192.807(a);192.807(b))
- **20.** Qualification of Personnel Inspecting Joints in Plastic Pipelines *Do person(s) inspecting joints in plastic pipelines demonstrate they are qualified to evaluate the acceptability of plastic pipe joints?* (DC.PLASTIC.PLASTICJOINTINSP.O) 192.287 (192.807(b))
- **21. Installation of Plastic Pipe** Does the operator's process require that plastic pipe be installed as required by §192.321? (DC.PLASTIC.INSTALLPLASTIC.P) 192.303 (192.321(a);192.321(b);192.321(c);192.321(e);192.321(f);192.321(g);192.321(h);192.321(i))
- **22. Installation of Plastic Pipe** Do records indicate plastic pipe was installed as required by 192.321? (DC.PLASTIC.INSTALLPLASTIC.R) 192.321(a) (192.321(b);192.321(c);192.321(d);192.321(e);192.321(f);192.321(g);192.321(h);192.321(i))
- **23. Installation of Plastic Pipe** *Do field observations confirm the plastic pipe is installed as required by 192.321?* (DC.PLASTIC.INSTALLPLASTIC.O) 192.321(a) (192.321(b);192.321(c);192.321(d);192.321(f);192.321(g);192.321(h);192.321(i))
- **24.** Underground Clearance Does the process require pipe to be installed with clearances specified in 192.325 and (if plastic) installed as to prevent heat damage to the pipe? (DC.CO.CLEARANCE.P) 192.303 (192.325(b);192.325(c))


 Note: this question is presented in multiple places so you will see multiple instances of it on this report.

GD.2024.01 Page 27 of 85

- **25.** Underground Clearance Do records indicate that mains are installed with clearances specified in 192.325, and (if plastic) installed as to prevent heat damage to the pipe? (DC.CO.CLEARANCE.R) 192.325(b) (192.325(c))

 Note: this question is presented in multiple places so you will see multiple instances of it on this report.
- **26. Underground Clearance** Do field observations indicate that mains are installed with the clearances specified in 192.325 and (if plastic) installed as to prevent heat damage to the pipe? (DC.CO.CLEARANCE.O) 192.325(b) (192.325(c)) **Note: this question is presented in multiple places so you will see multiple instances of it on this report.**
- **27. Trenchless Installation of Plastic Transmission and Main Pipelines** For plastic pipe Transmission and Main pipelines installed by trenchless excavation, does the process include steps that need to be taken to provide sufficient clearance for installation and maintenance activities from other underground utilities and/or structures at the time of installation? (DC.PLASTIC.PLASTICTRENCHLESS.P) 192.329(a) (192.303)
- **28. Trenchless Installation of Plastic Transmission and Main Pipelines** For plastic pipe Transmission and Main pipelines installed by trenchless excavation, do field observations confirm lines are being installed with sufficient clearance for installation and maintenance activities from other underground utilities and/or structures? (DC.PLASTIC.PLASTICTRENCHLESS.O) 192.329(a) (192.303)
- **29. Trenchless Installation of Plastic Lines using a Weak Link** Does the process require that during installation of plastic lines and plastic service lines, a "weak link" (as defined by §192.3) is utilized to ensure the pipeline will not be damaged by any excessive forces during the pulling process? (DC.PLASTIC.PLASTICWEAKLINK.P) 192.329(b) (192.376(b);192.303)
- **30.** Trenchless Installation of Plastic Lines using a Weak Link Do field observations confirm plastic lines and plastic service lines are being installed using a "weak link" (as defined by §192.3) to ensure the pipeline will not be damaged by any excessive forces during the pulling process? (DC.PLASTIC.PLASTIC.WEAKLINK.O) 192.329(b) (192.376(b);192.303)
- **31. Trenchless Installation of Plastic Service Lines** For plastic service lines installed by trenchless excavation, does the process include steps that need to be taken to provide sufficient clearance for installation and maintenance activities from other underground utilities and/or structures at the time of installation? (DC.PLASTIC.PLASTICSERVICE.P) 192.376(a) (192.303)
- **32. Trenchless Installation of Plastic Service Lines** For plastic service lines installed by trenchless excavation, do field observations confirm lines are being installed with sufficient clearance for installation and maintenance activities from other underground utilities and/or structures? (DC.PLASTIC.PLASTIC.PLASTICSERVICE.O) 192.376(a) (192.303)

GD.2024.01 Page 28 of 85

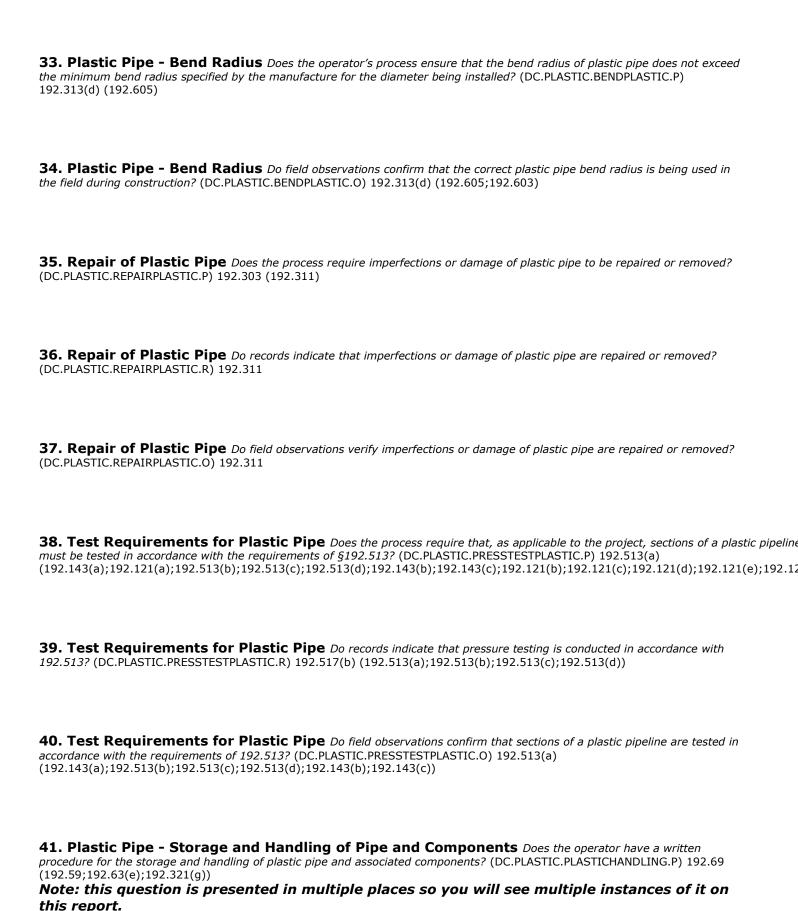

GD.2024.01 Page 29 of 85

42. Plastic Pipe - Storage and Handling of Pipe and Components *Do records indicate that the storage and handling of plastic pipe and associated plastic components were in accordance with noted procedures and applicable standards?* (DC.PLASTIC.PLASTICHANDLING.R) 192.69 (192.59;192.63(e);192.321(g))

Note: this question is presented in multiple places so you will see multiple instances of it on this report.

43. Plastic Pipe - Storage and Handling of Pipe and Components *Do field observations confirm plastic materials are stored and handled to ensure compliance with operator procedures?* (DC.PLASTIC.PLASTICHANDLING.O) 192.69 (192.59;192.63(e);192.65;192.67)

Note: this question is presented in multiple places so you will see multiple instances of it on this report.

44. Maintenance of Equipment Used in Joining of Plastic Pipe by Heat Fusion *Does the process require maintaining equipment used in joining of plastic pipe using heat fusion in accordance with the manufacturer's recommended practices or with written procedures that have been proven by test and experience to produce acceptable joints?* (MO.GM.EQUIPPLASTICJOINT.P) 192.605(b)(1) (192.756)

Note: this question is presented in multiple places so you will see multiple instances of it on this report.

45. Maintenance of Equipment Used in Joining of Plastic Pipe by Heat Fusion *Do records indicate equipment used in joining plastic pipe by heat fusion was maintained in accordance with the manufacturer's recommended practices or with written procedures that have been proven by test and experience to produce acceptable joints? (MO.GM.EQUIPPLASTICJOINT.R) 192.603(b) (192.756)*

Note: this question is presented in multiple places so you will see multiple instances of it on this report.

46. Maintenance of Equipment Used in Joining of Plastic Pipe by Heat Fusion *Is proper maintenance being performed on equipment used in joining plastic pipe by heat fusion in accordance with the manufacturer's recommended practices or with written procedures that have been proven by test and experience to produce acceptable joints?* (MO.GM.EQUIPPLASTICJOINT.O) 192.756

Note: this question is presented in multiple places so you will see multiple instances of it on this report.

47. Qualification of Personnel Making Joints in Plastic Pipelines Does the process require personnel making joints in plastic pipelines be qualified? (TQ.QUOMCONST.PLASTIC.P) 192.285(a) (192.285(d);192.805(b);192.285(c)) **Note: this question is presented in multiple places so you will see multiple instances of it on this report.**

GD.2024.01 Page 30 of 85

- **48.** Qualification of Personnel Inspecting Joints in Plastic Pipelines Does the process require that persons who inspect joints in plastic pipes be qualified? (TQ.QUOMCONST.PLASTICINSPECT.P) 192.287 (192.805(b)) Note: this question is presented in multiple places so you will see multiple instances of it on this report.
- **49. Qualification of Personnel Making Joints in Plastic Pipelines** *Do records indicate adequate qualification of personnel making/inspecting joints in plastic pipelines?* (TQ.QUOMCONST.PLASTIC.R) 192.285(a) (192.285(d);192.287;192.807(a);192.807(b);192.285(c))

Note: this question is presented in multiple places so you will see multiple instances of it on this report.

50. Qualification of Personnel Making Joints in Plastic Pipelines Do field observations verify personnel making/inspecting joints in plastic pipelines demonstrate adequate skills and knowledge? (TQ.QUOMCONST.PLASTIC.O) 192.285(a) (192.287;192.803)

Note: this question is presented in multiple places so you will see multiple instances of it on this report.

Emergency Preparedness and Response - Emergency Response

- **1. Receiving Notices** Does the emergency plan include procedures for receiving, identifying, and classifying notices of events which need immediate response? (EP.ERG.NOTICES.P) 192.615(a)(1)
- **2. Emergency Response Communication** Does the emergency plan include procedures for establishing and maintaining adequate means of communication with appropriate fire, police, and other public officials? (EP.ERG.COMMSYS.P) 192.615(a) (192.615(a)(2))
- **3. Emergency Response** Does the emergency plan include procedures for making a prompt and effective response to a notice of each type of emergency, including gas detected inside or near a building, a fire or explosion near or directly involving a pipeline facility, operational failure (including Cyber-attacks), or a natural disaster? (EP.ERG.RESPONSE.P) 192.615(a) (192.615(a)(3);192.615(a)(11);192.615(b)(1))
- **4. Emergency Response** Does the process include procedures for ensuring the availability of personnel, equipment, tools, and materials as needed at the scene of an emergency? (EP.ERG.READINESS.P) 192.615(a) (192.615(a)(4))

GD.2024.01 Page 31 of 85

5. Emergency Response - Actions Does the emergency plan include procedures for taking actions directed toward protecting people first and then property? (EP.ERG.PUBLICPRIORITY.P) 192.615(a) (192.615(a)(5))
6. Emergency Response Does the emergency plan include procedures for the emergency shutdown or pressure reduction in any section of pipeline system necessary to minimize hazards to life or property? (EP.ERG.PRESSREDUCESD.P) 192.615(a) (192.615(a)(6))
7. Emergency Response - Hazards Does the emergency plan include procedures for making safe any actual or potential hazard to life or property? (EP.ERG.PUBLICHAZ.P) 192.605(a) (192.615(a)(7))
8. Public Official Notification Does the emergency plan include procedures for notifying appropriate public officials of gas pipeline emergencies and coordinating with them both planned responses and actual responses during an emergency? (EP.ERG.AUTHORITIES.P) 192.615(a) (192.615(a)(8))
9. Emergency Response - Designated Persons Notify 911 Does the emergency plan define the operator's designated person(s) (e.g., controller or other personnel) responsible to directly notify 911 or the phone number of appropriate local emergency officials to report emergencies and possible pipeline ruptures to first responder agencies/authorities? (EP.ERG.NOTIFY911.P) 192.615(a) (192.615(a)(8);NTSB P-11-9)
10. Emergency Response - Designated Persons Notify 911 Do records indicate that immediate and direct notification was made to 911 emergency call centers (or local emergency responder agency) for the communities and jurisdictions in which pipelines were located for situations when an emergency or possible rupture of a pipeline was indicated? (EP.ERG.NOTIFY911.R) 192.615(a) (192.615(a)(8);NTSB P-11-9)
11. Service Outage Restoration Does the emergency plan include procedures for safely restoring any service outage? (EP.ERG.OUTAGERESTORE.P) 192.615(a) (192.615(a)(9))
12. Incident Investigation Actions Does the process include procedures for beginning action under 192.617, if applicable, as soon after the end of the emergency as possible? (EP.ERG.INCIDENTACTIONS.P) 192.615(a) (192.615(a)(10))
13. Incident Investigation Does the process include procedures for analyzing accidents and failures, including the selection of samples of the failed facility or equipment for laboratory examination, where appropriate, for the purpose of determining the causes of the failure and minimizing the possibility of recurrence? (EP.ERG.INCIDENTANALYSIS.P) 192.617

GD.2024.01 Page 32 of 85

- **14. Incident Investigation** Do records indicate actions initiated to analyze accidents and failures, including the collection of appropriate samples for laboratory examination to determine the causes of the failure and minimize the possibility of recurrence, in accordance with its procedures? (EP.ERG.INCIDENTANALYSIS.R) 192.605(a) (192.617)
- **15. Emergency Response Training** Does the process include training of the appropriate operating personnel to assure they are knowledgeable of the emergency procedures and verifying that the training is effective? (EP.ERG.TRAINING.P) 192.615(b)(2)
- **16. Emergency Response Training** Has the operator trained the appropriate operating personnel on emergency procedures and verified that the training was effective in accordance with its procedures? (EP.ERG.TRAINING.R) 192.605(a) (192.615(b)(2))
- **17. Emergency Response Performance** Does the process include detailed steps for reviewing employee activities to determine whether the procedures were effectively followed in each emergency? (EP.ERG.POSTEVNTREVIEW.P) 192.615(b)(3)
- **18. Emergency Response Performance** *Do records indicate review of employee activities to determine whether the procedures were effectively followed in each emergency?* (EP.ERG.POSTEVNTREVIEW.R) 192.605(a) (192.615(b)(1);192.615(b)(3))
- **19. Liaison with Public Officials** Does the process include steps for establishing and maintaining liaison with appropriate fire, police, other public officials, and 911 emergency call centers? (EP.ERG.LIAISON.P) 192.615(c) (192.615(c)(1);192.615(c)(2);192.615(c)(3);192.615(c)(4);192.616(c);ADB-2005-03)
- **20. Liaison with Public Officials** Do records indicate liaisons established and maintained with appropriate fire, police, other public officials, and 911 emergency call centers in accordance with procedures? (EP.ERG.LIAISON.R) 192.603(b) (192.615(c)(1);192.615(c)(2);192.615(c)(3);192.615(c)(4);192.616(c);ADB-2005-03)

Note: this question is presented in multiple places so you will see multiple instances of it on this report.

GD.2024.01 Page 33 of 85

Facilities and Storage - Facilities General

1. Abandonment or Deactivation of Pipe and Facilities Does the process include adequate requirements for the abandonment and deactivation of pipelines and facilities? (MO.GM.ABANDONPIPE.P) 192.605(b)(1) (192.727(a);192.727(b);192.727(d);192.727(e);192.727(f);192.727(g))

Note: this question is presented in multiple places so you will see multiple instances of it on this report.

- **2. Vault Inspection** What are process requirements for inspecting vaults having a volumetric internal content ≥200 cubic feet (5.66 cubic meters) that house pressure regulating/limiting equipment? (FS.FG.VAULTINSPECT.P) 192.605(b)(1) (192.749(a);192.749(b);192.749(d))
- **3. Vault Inspection** Do records document the adequacy of inspections of all vaults having an internal volume ≥200 cubic feet (5.66 cubic meters) that house pressure regulating/limiting equipment? (FS.FG.VAULTINSPECT.R) 192.709(c) (192.749(a);192.749(b);192.749(d))
- **4. Vault Inspection** Are inspections of selected vaults with internal volume ≥200 cubic feet (5.66 cubic meters) housing pressure regulating/limiting equipment adequate? (FS.FG.VAULTINSPECT.O) 192.749(a) (192.749(b);192.749(c);192.749(d))

Maintenance and Operations - Gas Pipeline Abnormal Operations

1. Abnormal Operations (Review) Do records indicate periodic review of work done by operator personnel to determine the effectiveness of the abnormal operation processes and corrective action taken where deficiencies are found? (MO.GOABNORMAL.ABNORMALREVIEW.R) 192.605(a) (192.605(c)(4))

Maintenance and Operations - Gas Pipeline Class Location

1. Change in Class Location Confirmation or Revision of MAOP Does the process include a requirement that the MAOP of a pipeline segment be confirmed or revised within 24 months whenever the hoop stress corresponding to the established MAOP is determined not to be commensurate with the existing class location? (MO.GOCLASS.CLASSLOCATEREV.P) 192.605(b)(1) (192.611(a);192.611(b);192.611(d))

GD.2024.01 Page 34 of 85

- **2. Change in Class Location Required Study** Does the process include a requirement that the operator conduct a study whenever an increase in population density indicates a change in the class location of a pipeline segment operating at a hoop stress that is more than 40% SMYS? (MO.GOCLASS.CLASSLOCATESTUDY.P) 192.605(b)(1) (192.609(a);192.609(b);192.609(d);192.609(e);192.609(f))
- **3. Change in Class Location Required Study** *Do records indicate performance of the required study whenever the population along a pipeline increased or there was an indication that the pipe hoop stress was not commensurate with the present class location?* (MO.GOCLASS.CLASSLOCATESTUDY.R) 192.605(b)(1) (192.609(a);192.609(b);192.609(d);192.609(e);192.609(f))

Maintenance and Operations - Gas Pipeline MAOP

- **1. Maximum Allowable Operating Pressure Determination** Does the process include requirements for determining the maximum allowable operating pressure for a pipeline segment in accordance with 192.619? (MO.GOMAOP.MAOPDETERMINE.P) 192.605(b)(1) (192.619(a);192.621(b);192.621(a);192.621(b);192.623(b))
- **2. Maximum Allowable Operating Pressure** *Do records indicate determination of the MAOP of pipeline segments in accordance with 192.619 and limiting of the operating pressure as required?* (MO.GOMAOP.MAOPDETERMINE.R) 192.619(a) (192.619(b);192.621(a);192.623(b);192.623(b))
- **3. Normal Operations and Maintenance Procedures** Does the process include requirements for starting up and shutting down any part of the pipeline in a manner to assure operation with the MAOP limits, plus the build-up allowed for operation of pressure-limiting and control devices? (MO.GOMAOP.MAOPLIMIT.P) 192.605(a) (192.605(b)(5))

Maintenance and Operations - Gas Pipeline Maintenance

1. Abandonment or Deactivation of Pipe and Facilities Does the process include adequate requirements for the abandonment and deactivation of pipelines and facilities? (MO.GM.ABANDONPIPE.P) 192.605(b)(1) (192.727(a);192.727(b);192.727(d);192.727(e);192.727(f);192.727(g))

Note: this question is presented in multiple places so you will see multiple instances of it on this report.

GD.2024.01 Page 35 of 85

2. Abandonment or Deactivation of Pipeline and Facilities <i>Do records indicate pipelines and facilities were abandoned or deactivated in accordance with requirements?</i> (MO.GM.ABANDONPIPE.R) 192.709(c) (192.727(a);192.727(b);192.727(d);192.727(e);192.727(f);192.727(g))
3. Prevention of Accidental Ignition Are there processes for minimizing the danger of accidental ignition where gas constitutes a hazard of fire or explosion? (MO.GM.IGNITION.P) 192.605(b)(1) (192.751(a);192.751(b);192.751(c))
4. Prevention of Accidental Ignition Do records indicate personnel followed processes for minimizing the danger of accidental ignition where the presence of gas constituted a hazard of fire or explosion? (MO.GM.IGNITION.R) 192.709 (192.751(a);192.751(b);192.751(c))
5. Valve Maintenance Distribution Lines Does the process include procedures for inspecting and partially operating each distribution system valve that might be required in an emergency at intervals not exceeding 15 months, but at least once each calendar year and for taking prompt remedial action to correct any valve found inoperable? (MO.GM.DISTVALVEINSPECT.P) 192.605(b)(1) (192.747(a);192.747(b))
6. Valve Maintenance Distribution Lines Do records indicate proper inspection of each distribution system valve that might be required in an emergency at intervals not exceeding 15 months, but at least once each calendar year, and prompt remedial action to correct any valve found inoperable? (MO.GM.DISTVALVEINSPECT.R) 192.603(b) (192.747(a);192.747(b))
7. Valve Maintenance Distribution Lines <i>Is proper inspection being performed for each distribution system valve that might be required in an emergency, and prompt remedial action to correct any valves found inoperable?</i> (MO.GM.DISTVALVEINSPECT.O) 192.747(a) (192.747(b))
8. Bell and Spigot Joints Does the process require that caulked bell and spigot joints be correctly sealed? (MO.GM.BELLSPIGOTJOINT.P) 192.753(a) (192.753(b))
9. Bell and Spigot Joints Do records indicate that caulked bell and spigot joints were correctly sealed? (MO.GM.BELLSPIGOTJOINT.R) 192.603(b) (192.753(a);192.753(b))
10. Bell and Spigot Joints Do records indicate that caulked bell and spigot joints were correctly sealed? (MO.GM.BELLSPIGOTJOINT.O) 192.753(a) (192.753(b))

GD.2024.01 Page 36 of 85

11. Protecting Cast-Iron Pipeline	Does the process require adequate protection for segments of a buried cast-iro	n
pipeline for which support has been disturbed?	? (MO.GM.CASTIRONPROTECT.P) 192.755(a) (192.755(b))	

- **12. Protecting Cast-Iron Pipeline** *Is adequate protection in place for segments of a buried cast-iron pipeline for which support has been disturbed?* (MO.GM.CASTIRONPROTECT.O) 192.755(a) (192.755(b))
- **13. Holders** Does the process include systematic and routine testing and inspection of pipe-type or bottle-type holders? (MO.GM.HOLDER.P) 192.605(a) (192.605(b)(10))
- **14. Maintenance of Equipment Used in Joining of Plastic Pipe by Heat Fusion** Does the process require maintaining equipment used in joining of plastic pipe using heat fusion in accordance with the manufacturer's recommended practices or with written procedures that have been proven by test and experience to produce acceptable joints? (MO.GM.EQUIPPLASTICJOINT.P) 192.605(b)(1) (192.756)

Note: this question is presented in multiple places so you will see multiple instances of it on this report.

15. Maintenance of Equipment Used in Joining of Plastic Pipe by Heat Fusion Do records indicate equipment used in joining plastic pipe by heat fusion was maintained in accordance with the manufacturer's recommended practices or with written procedures that have been proven by test and experience to produce acceptable joints? (MO.GM.EQUIPPLASTICJOINT.R) 192.603(b) (192.756)

Note: this question is presented in multiple places so you will see multiple instances of it on this report.

16. Maintenance of Equipment Used in Joining of Plastic Pipe by Heat Fusion *Is proper maintenance* being performed on equipment used in joining plastic pipe by heat fusion in accordance with the manufacturer's recommended practices or with written procedures that have been proven by test and experience to produce acceptable joints? (MO.GM.EQUIPPLASTICJOINT.O) 192.756

Note: this question is presented in multiple places so you will see multiple instances of it on this report.

17. Plastic Leak Repair - Mechanical Clamps Does the operator's process ensure that mechanical leak clamps are not used as a permanent repair method for plastic pipe? (AR.RCOM.PLASTICLEAKCLAMP.P) 192.720

Note: this question is presented in multiple places so you will see multiple instances of it on this report.

GD.2024.01 Page 37 of 85

- 18. Plastic Leak Repair Mechanical Clamps Do records indicate that mechanical leak clamp repairs for plastic pipe are documented with date installed, location, and date of removal? (AR.RCOM.PLASTICLEAKCLAMP.R) 192.720

 Note: this question is presented in multiple places so you will see multiple instances of it on this report.
- 19. Plastic Leak Repair Mechanical Clamps Do field observations verify that mechanical leak clamp repairs for plastic pipe were installed and documented properly? (AR.RCOM.PLASTICLEAKCLAMP.O) 192.720 (192.605;192.603)

 Note: this question is presented in multiple places so you will see multiple instances of it on this report.

Maintenance and Operations - Gas Pipeline Odorization

- **1. Odorization of Gas** Does the process ensure appropriate odorant levels are contained in its combustible gases in accordance with 192.625? (MO.GOODOR.ODORIZE.P) 192.605(b)(1) (192.625(a);192.625(b);192.625(c);192.625(d);192.625(e);192.625(f))
- **2. Odorization of Gas** Do records indicate appropriate odorization of its combustible gases in accordance with its processes and conduct of the required testing to verify odorant levels met requirements? (MO.GOODOR.ODORIZE.R) 192.709(c) (192.625(a);192.625(b);192.625(c);192.625(e);192.625(f))
- **3. Odorization of Gas** *Is sampling of combustible gases adequate using an instrument capable of determining the percentage of gas in air at which it becomes readily detectable?* (MO.GOODOR.ODORIZE.O) 192.625(a) (192.625(c);192.625(e);192.625(f))

Maintenance and Operations - Gas Pipeline Operations

1. Continuing Surveillance Are there processes for performing continuing surveillance of pipeline facilities, and also for reconditioning, phasing out, or reducing the MAOP in a pipeline segment that is determined to be in unsatisfactory condition but on which no immediate hazard exists? (MO.GO.CONTSURVEILLANCE.P) 192.605(e) (192.613(a);192.613(b);192.703(b);192.703(c)) Note: this question is presented in multiple places so you will see multiple instances of it on this report.

GD.2024.01 Page 38 of 85

2. Continuing Surveillance Do records indicate performance of continuing surveillance of facilities as required, and also the reconditioning, phasing out, or MAOP reduction in any pipeline segment that was determined to be in unsatisfactory condition but on which no immediate hazard existed? (MO.GO.CONTSURVEILLANCE.R) 192.605(b)(3) (192.613(a);192.613(b);192.703(b);192.703(c))

Note: this question is presented in multiple places so you will see multiple instances of it on this report.

3. Continuing Surveillance Are unsatisfactory conditions being captured and addressed by continuing surveillance of facilities and the pipeline as required by 192.613? (MO.GO.CONTSURVEILLANCE.O) 192.605(b)(3) (192.613(b);192.703(a);192.703(b);192.703(c))

Note: this question is presented in multiple places so you will see multiple instances of it on this report.

- **4. Pipeline Purging** Does the process include requirements for purging of pipelines in accordance with 192.629? (MO.GO.PURGE.P) 192.605(b)(1) (192.629(a);192.629(b))
- 5. Pipeline Purging Are lines being purged in accordance with 192.629? (MO.GO.PURGE.O) 192.629(a) (192.629(b))
- **6. Normal Maintenance and Operations** Does the process include a requirement to review the manual at intervals not exceeding 15 months, but at least once each calendar year? (MO.GO.OMANNUALREVIEW.P) 192.605(a)
- **7. Normal Maintenance and Operations** Have annual reviews of the written procedures or processes in the manual been conducted as required? (MO.GO.OMANNUALREVIEW.R) 192.605(a)
- **8. Normal Operations and Maintenance Procedures Review** Does the process include requirements for periodically reviewing the work done by operator personnel to determine the effectiveness, and adequacy of the processes used in normal operations and maintenance and modifying the processes when deficiencies are found? (MO.GO.OMEFFECTREVIEW.P) 192.605(a) (192.605(b)(8))
- **9. Normal Operations and Maintenance Procedures Review** Do records indicate periodic review of the work done by operator personnel to determine the effectiveness, and adequacy of the processes used in normal operations and maintenance and modifying the processes when deficiencies are found? (MO.GO.OMEFFECTREVIEW.R) 192.605(a) (192.605(b)(8))

GD.2024.01 Page 39 of 85

10. Normal Operations and Maintenance Procedures - History Does the process include requirements making construction records, maps and operating history available to appropriate operating personnel? (MO.GO.OMHISTORY.I 192.605(a) (192.605(b)(3))	
11. Normal Operations and Maintenance Procedures - History Are construction records, maps and operating history available to appropriate operating personnel? (MO.GO.OMHISTORY.R) 192.605(a) (192.605(b)(3))	
12. Safety Related Conditions Does the process include instructions enabling personnel who perform operation and maintenance activities to recognize conditions that may potentially be safety-related conditions? (MO.GO.SRC.P) 192.605(a) (192.605(d);191.23(a))	1
13. Customer Notification <i>Is a customer notification process in place that satisfies the requirements of 192.16?</i> (MO.GO.CUSTNOTIFY.P) 192.13(c) (192.16(a);192.16(b);192.16(c);192.16(d))	
14. Customer Notification Do records indicate the customer notification process satisfies the requirements of 192.16 (MO.GO.CUSTNOTIFY.R) 192.16(d) (192.16(a);192.16(b);192.16(c))	i?
15. EFV Installation <i>Is there an adequate excess flow valve (EFV) installation and performance program in place?</i> (MO.GO.EFVINSTALL.P) 192.383(b) (192.381(a);192.381(b);192.381(c);192.381(d);192.381(e);192.383(a);192.383(c))	
16. Gas Odor Response Does the process require prompt response to the report of a gas odor inside or near a buildin (MO.GO.ODDOR.P) 192.605(a) (192.605(b)(11))	g?

Maintenance and Operations - Gas Pipeline Overpressure Protection

1. Pressure Limiting and Regulating Stations Capacity of Relief Devices Does the process include procedures for ensuring that the capacity of each pressure relief device at pressure limiting stations and pressure regulating stations is sufficient? (MO.GMOPP.PRESSREGCAP.P) 192.605(b)(1) (192.743(a);192.743(b);192.743(c))

GD.2024.01 Page 40 of 85

Survey and Monitoring 1. Transmission Patrolling Requirements Does the process adequately cover the requirements for transmission
Maintenance and Operations - ROW Markers, Patrols, Leakage
7. Pressure Telemetering or Recording Gauges Are telemetering or recording gauges properly utilized as required for distribution systems? (MO.GMOPP.PRESSREGMETER.O) 192.741(a) (192.741(b);192.741(c))
6. Pressure Telemetering or Recording Gauges Does the process require telemetering or recording gauges be utilized as required for distribution systems? (MO.GMOPP.PRESSREGMETER.P) 192.605(b)(1) (192.741(a);192.741(b);192.741(c)
5. Pressure Limiting and Regulating Stations Inspection and Testing <i>Are field or bench tests or inspections of regulating stations, pressure limiting stations or relief devices adequate?</i> (MO.GMOPP.PRESSREGTEST.O) 192.739(a) (192.739(b))
4. Pressure Limiting and Regulating Stations Inspection and Testing Do records indicate inspection and testing of pressure limiting, relief devices, and pressure regulating stations? (MO.GMOPP.PRESSREGTEST.R) 192.709(c) (192.739(a);192.739(b))
3. Pressure Limiting and Regulating Stations Inspection and Testing Does the process include procedures for inspecting and testing each pressure limiting station, relief device, and pressure regulating station and their equipment? (MO.GMOPP.PRESSREGTEST.P) 192.605(b)(1) (192.739(a);192.739(b))
2. Pressure Limiting and Regulating Stations Capacity of Relief Devices Do records indicate testing or review of the capacity of each pressure relief device at each pressure limiting station and pressure regulating station as required? (MO.GMOPP.PRESSREGCAP.R) 192.709(c) (192.743(a);192.743(b);192.743(c))

line patrolling the ROW and conditions reported? (MO.RW.TRANSPATROL.P) 192.705(a) (192.705(b);192.705(c))

been patrolled as required? (MO.RW.TRANSPATROL.R) 192.709(c) (192.705(a);192.705(b);192.705(c))

2. Transmission Patrolling Requirements Do records indicate that transmission line ROW surface conditions have

GD.2024.01 Page 41 of 85

3. Transmission Leakage Surveys Does the process require transmission leakage surveys to be conducted? (MO.RW.TRANSLEAKAGE.P) 192.706 (192.706(a);192.706(b))
4. Transmission Leakage Surveys Do records indicate transmission leakage surveys conducted as required? (MO.RW.TRANSLEAKAGE.R) 192.709(c) (192.706;192.706(a);192.706(b))
5. Business District Definition Do the procedures define a "Business District"? (MO.RW.BUSINESSDIST.P) 192.723(b)(1) (192.721(b)(1);192.723(a);192.613)
6. Business District Definition Do the records clearly identify the areas of operator's distribution system that are considered Business Districts? (MO.RW.BUSINESSDIST.R) 192.723(b)(1) (192.721(b)(1);192.723(a);192.613)
7. Business District Definition Do field observations indicate Business Districts are properly identified? (MO.RW.BUSINESSDIST.O) 192.723(b)(1) (192.721(b)(1);192.723(a);192.613)
8. Distribution Patrolling Does the process require distribution system patrolling to be conducted? (MO.RW.DISTPATROL.P) 192.721(a) (192.721(b))
9. Distribution Patrolling Do records indicate distribution patrolling was conducted as required? (MO.RW.DISTPATROL.R) 192.603(b) (192.721(a);192.721(b))
10. Distribution Leakage Surveys Does the process require distribution system leakage surveys to be conducted? (MO.RW.DISTLEAKAGE.P) 192.723(a) (192.723(b))
11. Distribution Leakage Surveys Do records indicate distribution leakage surveys were conducted as required? (MO.RW.DISTPATROLLEAKAGE.R) 192.603(b) (192.723(a);192.723(b))

GD.2024.01 Page 42 of 85

s?
g

GD.2024.01 Page 43 of 85

Gas Distribution Integrity Management - Plan Implementation

1.	Plan 1	[mplementa	tion - Impleme	ent Date	Was the plan	written and	implemented	per the	requirement d	f
192	2.1005 b	y 08/02/2011? ((GDIM.QA.PLANIMPL	EMENT.P)	192.1005					

2. Plan Implementation - Data Sources <i>Do the procedures identify or reference the appropriate sources used to</i>
determine certain characteristics (e.g., Design, Operating Conditions, Operating Environmental Factors) necessary to assess the
threats and risks to the pipeline? (GDIM.RA.SOURCES.P) 192.1007(a)(1)

Gas Distribution Integrity Management - Knowledge of the System

- **1. System Knowledge Information Considered** Do the procedures require the consideration of information gained from past design, operations, and maintenance (e.g., O&M activities, field surveys, One-Call system information, excavation damage, etc.)? (GDIM.RA.INFORMATION.P) 192.1007(a)(2)
- **2. System Knowledge Gaps** Does the plan contain procedures to identify additional information that is needed to fill gaps due to missing, inaccurate, or incomplete records? (GDIM.RA.GAPS.P) 192.1007(a)(3)
- **3. System Knowledge Information Needed** Do the procedures specify the means to collect the additional information needed to fill gaps due to missing, inaccurate, or incomplete records (e.g., O&M activities, field surveys, One-Call System, etc.)? (GDIM.RA.INFONEEDS.P) 192.1007(a)(3)
- **4. System Knowledge Information Needed** Does the plan list the additional information needed to fill gaps due to missing, inaccurate, or incomplete records? (GDIM.RA.INFONEEDS.R) 192.1007(a)(3)
- **5. System Knowledge New Pipe Data** Do the procedures require the capture and retention of data on any new pipeline installed? (GDIM.RA.NEWPIPEDATA.P) 192.1007(a)(5)
- **6. System Knowledge New Pipe Data** Does the data required for capture and retention include, at a minimum, the location where the new pipeline is installed and the material from which it is constructed? (GDIM.RA.NEWPIPEDATA.R) 192.1007(a)(5)

GD.2024.01 Page 44 of 85

7. System Knowledge - Implementation Do records demonstrate implementation of the element "Knowledge of t System"? (GDIM.RA.DEMOKNOWLEDGE.R) 192.1007(a)	he
8. System Knowledge - Understanding Has the operator demonstrated an adequate understanding of the system? (GDIM.RA.DEMOUNDERSTANDING.R) 192.1007(a)	?
Gas Distribution Integrity Management - Identify Threats	
1. Identify Threats - Information Considered Did the operator consider the information that was reasonably available to identify existing and potential threats? (GDIM.RA.INFOCONSIDERED.P) 192.1007(b)	
2. Identify Threats - Information Considered In identifying threats did the information considered include all of the required data and information sources? (GDIM.RA.INFOCONSIDERED.R) 192.1007(b)	F
3. Identify Threats - Outside Sources Do the procedures consider, in addition to the operator's own information, data from external sources (e.g. trade associations, government agencies, or other system operators, etc.) to assist in identifying potential threats? (GDIM.RA.OUTSIDESOURCES.P) 192.1007(b)	ıg
4. Identify Threats - Threats Considered In identifying threats, do the procedures include consideration of all of trequired threat categories to each gas distribution pipeline? (GDIM.RA.THREATCATEGORIES.P) 192.1007(b)	the
5. Identify Threats - Implementation Do records demonstrate implementation of the element "Identify Threats"? (GDIM.RA.IMPLEMENTTH.R) 192.1007(b)	

GD.2024.01 Page 45 of 85

Gas Distribution Integrity Management - Evaluate and Rank Risk

1. Rank Risk - Methodology Do the procedures contain the method(s) and/or a model used to determine the relative importance of each threat and estimate and rank the risks posed? (GDIM.RA.RISKRANKING.P) 192.1007(c)
2. Rank Risk - Threats Considered Do the procedures to evaluate and rank risk consider each applicable current and potential threat? (GDIM.RA.THREATSCONSIDERED.P) 192.1007(c)
3. Rank Risk - Likelihood Do the procedures to evaluate and rank risk consider the likelihood of failure associated with each threat? (GDIM.RA.LIKELIHOOD.P) 192.1007(c)
4. Rank Risk - Consequences Do the procedures to evaluate and rank risk consider the potential consequence of failure for all applicable threats? (GDIM.RA.CONSEQUENCE.P) 192.1007(c)
5. Rank Risk - System Subdivision If subdivision of system occurs, does the plan subdivide the system into regions with similar characteristics and for which similar actions are likely to be effective in reducing risk? (GDIM.RA.SUBDIVIDE.R) 192.1007(c)
6. Rank Risk - Results Are the results of the risk ranking supported by the risk evaluation model/method? (GDIM.RA.RESULTS.R) 192.1007(c)
7. Rank Risk - Validation Did the operator validate the results generated by the risk evaluation model/method? (GDIM.RA.RESULTSVALIDATION.R) 192.1007(c)
8. Rank Risk - Implementation Do records demonstrate implementation of the element "Evaluate and Rank Risk"? (GDIM.RA.IMPLEMENTRR.R) 192.1007(c)

GD.2024.01 Page 46 of 85

Gas Distribution Integrity Management - Preventive and Mitigative Actions

	1. Measures to Reduce Risk - Identification Does the plan include procedures to identify when measures, beyond
1	minimum code requirements specified outside of Part 192 Subpart P, are required to reduce risk?
	(GDIM.PM.IDENTIFYMEASURES.P) 192.1007(d)

- **2. Measures to Reduce Risk Identification** When measures, beyond minimum code requirements specified outside of Part 192 Subpart P, are required to reduce risk, does the plan identify the measures selected, how they will be implemented, and the risks they are addressing? (GDIM.PM.IDENTIFYMEASURES.R) 192.1007(d)
- **3. Measures to Reduce Risk Leak Management** Does the plan include an effective leak management program (unless all leaks are repaired when found)? (GDIM.PM.LEAKMANAGEMENT.P) 192.1007(d)
- **4. Measures to Reduce Risk Implementation** *Do records demonstrate implementation of the measures, required by Part 192 Subpart P, to reduce risk?* (GDIM.PM.IMPLEMENTPM.R) 192.1007(d)

Gas Distribution Integrity Management - Measure Performance and Evaluate Effectiveness

- **1. Measure Performance Baseline** Does the plan contain procedures for how the operator established a baseline for each performance measure? (GDIM.QA.PERFMEASUREBASELINE.P) 192.1007(e)
- **2. Measure Performance Baseline** Does the plan establish a baseline for each performance measure? (GDIM.QA.PERFMEASUREBASELINE.R) 192.1007(e)
- **3. Measure Performance Data Collection** Does the operator have procedures to collect the data for each performance measure? (GDIM.QA.PERFMEASUREDATA.P) 192.1007(e)

GD.2024.01 Page 47 of 85

4. Measure Performance - Monitoring Do the procedures require the operator to monitor each performance measure? (GDIM.QA.PERFMEASUREMONITOR.P) 192.1007(e)
5. Measure Performance - Measure Effectiveness When measures are required to reduce risk, does the plan provide/describe what type and/or what specific performance measures will be used to measure effectiveness? (GDIM.QA.MEASUREEFFECTIVENESS.P) 192.1007(e)
6. Measure Performance - Implementation Do records demonstrate implementation of the element "Measure Performance, Monitor Results, and Evaluate Effectiveness"? (GDIM.QA.IMPLEMENTEV.R) 192.1007(e)
Cas Distribution Integrity Management - Deviedic Fugluation
Gas Distribution Integrity Management - Periodic Evaluation
1. Periodic Evaluation - Requirements Do the procedures for periodic evaluation include all of the requirements of §192.1007(f)? (GDIM.CA.PERIODICEVAL.P) 192.1007(f)
2. Periodic Evaluation - Implementation Do records demonstrate implementation of the element "Periodic Evaluation and Improvement"? (GDIM.CA.PERIODICEVAL.R) 192.1007(f)
Gas Distribution Integrity Management - Reporting
1. Report Results - Performance Measures Does the plan contain or reference procedures for reporting, on an annual basis, the four measures listed in 192.1007(e)(1)(i) through (e)(1)(iv) to PHMSA as part of the annual report required by 191.11 and the State regulatory authority? (GDIM.RR.ANNUALREPORT.P) 192.1007(g)
2. Report Results - Submittal Has the operator submitted the required reports? (GDIM.RR.SUBMITREPORTS.R) 192.1007(g)

GD.2024.01 Page 48 of 85

Gas Distribution Integrity Management - Records Required to be Kept

t P will
2
NTS.R)
ous
e.g.
s to
nd data

5. System Knowledge - Information Needed (O&M) Has any new or missing information identified or acquired during normal operations, maintenance, and inspection activities been incorporated into the DIMP plan?

(GDIM.RA.OMINFONEEDSIMPL.R) 192.1007(a)(3)

GD.2024.01 Page 49 of 85

6. System Knowledge - New Pipe Data Have required data on any new pipeline installations since August 2, 2011 been captured (e.g., location, wall thickness/SDR, manufacturer, lot/production number)? (GDIM.RA.NEWPIPEIMPL.R) 192.1007(a)(5)
7. System Knowledge - Data Collection Forms Are data collection forms used in conjunction with the operator's DIMP plan being fully and accurately completed? (GDIM.RA.DATAFORMIMPL.R) 192.1007(a)
8. System Knowledge - SME Input If Subject Matter Experts (SMEs), is their documented knowledge and experience being appropriately used in the DIMP Program? (GDIM.RA.SMEIMPL.R) 192.1007(a)
9. System Knowledge - Understanding Do operator personnel in the field understand their responsibilities under the DIMP plan? (GDIM.RA.DEMOUNDERSTANDINGIMPL.O) 192.1007(a)
10. Identify Threats - Threats Considered (New Information) Has the operator acquired any new information relevant to system knowledge that may affect its threat identification? (GDIM.RA.THREATCATEGORIESIMPL.R) 192.1007(b)
11. Identify Threats - Information Considered (Changes) Have any changes occurred that require re-evaluation of threats and risks? (GDIM.RA.INFOCONSIDEREDIMPL.R) 192.1007(b)
12. Identify Threats - Implementation (Update) Since the last DIMP plan review by the regulatory agency, has the threat identification and risk assessment been updated based on newly acquired information or data relevant to system knowledge? (GDIM.RA.IMPLEMENTTHUPDATEIMPL.R) 192.1007(c)
13. Identify Threats - Implementation (DIMP Process) If the threat identification and risk evaluation and ranking have been modified, were the revisions made in accordance with the procedure in the DIMP plan? (GDIM.RA.IMPLEMENTTHUPDATEPLANIMPL.R) 192.1007(c)
14. Rank Risk - System Subdivision (Adequacy) Does the current subdivision process (grouping of materials, geographic areas, etc.) adequately meet the need to properly evaluate and rank the existing and potential threats to the integrity

of the system? (GDIM.RA.SUBDIVIDEADEQIMPL.R) 192.1007(c)

GD.2024.01 Page 50 of 85

15. Rank Risk - System Subdivision (Update) Have the system subdivisions within the risk evaluation and ranking been added to or modified since the last plan review by the regulatory agency? (GDIM.RA.SUBDIVIDEUPDATEIMPL.R) 192.1007(c)
16. Rank Risk - System Subdivision (DIMP) If system subdivisions have been added or modified, was it done in accordance with the procedures described in the DIMP plan? (GDIM.RA.SUBDIVIDEDIMPIMPL.R) 192.1007(c)
17. Rank Risk - System Subdivision (Result) If system subdivisions have been added or modified, did the new system subdivision result in modifications to the risk evaluation and ranking? (GDIM.RA.SUBDIVIDERESULTIMPL.R) 192.1007(c)
18. Measures to Reduce Risk - Implementation (Update) Does documentation reviewed demonstrate that measures to reduce risks per the DIMP plan are being implemented? (GDIM.PM.IMPLEMENTPMIMPL.R) 192.1007(d)
19. Measures to Reduce Risk - Implementation (Completion) Have any measures to reduce risks resulting in the elimination/mitigation of the associated identified threat been completed (e.g., pipe replacement program completed, etc.)? (GDIM.PM.IMPLEMENTPMCOMPLETEIMPL.R) 192.1007(d)
20. Measures to Reduce Risk - Implementation (Re-Evaluate) Have risks been re-evaluated and re-ranked because of the elimination/mitigation of an identified threat? (GDIM.PM.IMPLEMENTPMREEVALIMPL.R) 192.1007(d)
21. Measures to Reduce Risk - Implementation (Specific Risk) Does each implemented risk reduction measure identified in the DIMP plan address a specific risk or group of risks? (GDIM.PM.IMPLEMENTPMSPECIFRISKIMPL.R) 192.1007(d)
22. Measures to Reduce Risk - Leak Management Can the operator provide documentation to demonstrate that an effective leak management program is being implemented (answer "N/A" if all leaks are repaired when found)? (GDIM.PM.LEAKMANAGEMENTIMPL.R) 192.1007(d)

23. Measure Performance - Implementation (Data) *Is data being collected for the required performance measures in 192.1007(e)?* (GDIM.QA.IMPLEMENTEVDATAIMPL.R) 192.1007(e)

GD.2024.01 Page 51 of 85

24. Measure Performance - Implementation (DIMP) Based on field observations and/or record reviews, is the data used to measure performance being accurately collected in accordance with the procedures in its DIMP plan? (GDIM.QA.IMPLEMENTEVDATADIMPIMPL.R) 192.1007(e)
25. Measure Performance - Implementation (Baseline) <i>Is each performance measure being monitored from an established baseline?</i> (GDIM.QA.IMPLEMENTEVBASELINEIMPL.R) 192.1007(e)
26. Measure Performance - Implementation (Specific Risk) <i>Is each performance measure added since the DIMP plan was last updated tied to a specific risk reduction measure or group of measures?</i> (GDIM.QA.IMPLEMENTEVRISKIMPL.R) 192.1007(e)
27. Periodic Evaluation - Implementation (Frequency) Have periodic evaluations of the DIMP plan been performed on the frequency specified in the plan? [If a periodic evaluation has not been required since plan implementation or the last inspection, mark questions 27-32 as "N/A".] (GDIM.CA.PERIODICEVALFREQIMPL.R) 192.1007(f)
28. Periodic Evaluation - Implementation (Requirements) Did the periodic evaluation include all required elements? (GDIM.CA.PERIODICEVALREQTSIMPL.R) 192.1007(f)
29. Periodic Evaluation - Implementation (High Risk) If any established performance measures indicated an increase in risk beyond an acceptable level (as established in the DIMP plan), were new risk reduction measures implemented along with their associated performance measures? (GDIM.CA.PERIODICEVALHIRISKIMPL.R) 192.1007(f) (192.1007(e))
30. Periodic Evaluation - Implementation (Risk Reduction Measures) If the periodic evaluation indicates that implemented measures to reduce risks are NOT effective, were risk reduction measures modified, deleted or added? (GDIM.CA.PERIODICEVALRISKREDIMPL.R) 192.1007(f)
31. Periodic Evaluation - Implementation (Performance Measures) Did the periodic evaluation indicate that the selected performance measures are assessing the effectiveness of risk reduction measures, and, if not, were performance measures modified, deleted or added? (GDIM.CA.PERIODICEVALPRFMESIMPL.R) 192.1007(f)

32. Periodic Evaluation - Implementation (DIMP Plan) Were procedures followed in conducting periodic evaluations and program improvements? (GDIM.CA.PERIODICEVALDIMPIMPL.R) 192.1007(f)

GD.2024.01 Page 52 of 85

33. Report Results - Submittal Were Parts C and D of the PHMSA Distribution Annual Report (Form 7100.1-1) completed in the submission to PHMSA and the state regulatory authority having jurisdiction, if required, for each year since the last inspection? (GDIM.RR.SUBMITREPORTSIMPL.R) 192.1007(g)
34. Records - Implementation Are records retained demonstrating compliance with Subpart P, as specified in its DIMP plan, for 10 years (or since 08/02/2011)? (GDIM.QA.RECORDREQUIREMENTSIMPL.R) 192.1011
35. Records - Implementation (Plan Retention) Were copies of superseded DIMP plans retained for 10 years (or since 08/02/2011)? (GDIM.QA.RECORDREQTSRETAINIMPL.R) 192.1011
36. Records - Implementation (DIMP) Were DIMP procedures followed as applicable to records retention? (GDIM.QA.RECORDREQTSDIMPIMPL.R) 192.1011
37. Deviation from Periodic Inspections - Approval Has approval been requested or received from PHMSA or the appropriate State Regulatory Authority for alternate (less strict than code) periodic inspection intervals? [If no, mark Subgroup GDIM.IMPL questions 40-44 "N/A".] (GDIM.PI.PERIODICINSPDEVAPPRVIMPL.R) 192.1013(c)
38. Deviation from Periodic Inspections - Implementation Have the periodic inspections been implemented and have they been conducted at the specified (approved) alternate intervals? (GDIM.PI.PERIODICINSPDEVPERFRMIMPL.R) 192.1013(c)
39. Deviation from Periodic Inspections - Requirements or Conditions Have all conditions been complied with that were required as part of the alternate inspection interval approval? (GDIM.PI.PERIODICINSPDEVREQTIMPL.R) 192.1013(c)
40. Deviation from Periodic Inspections - Performance Measures Do performance measure records indicate that deviation inspection resources were assigned to higher risk threat(s) and/or that that decreased inspection intervals contributed to an equal or greater overall level of safety has been achieved since the alternate inspection frequency was implemented? (GDIM.PI.PERIODICINSPDEVPRFMESIMPL.R) 192.1013(c)

41. Deviation from Periodic Inspections - Corrective Action *If that an equal or greater overall level of safety has not been achieved, has corrective action been taken?* (GDIM.PI.PERIODICINSPDEVACTIONIMPL.R) 192.1013(c)

GD.2024.01 Page 53 of 85

Small LPG Distribution Integrity Management - Plan Implementation

1. Plan Implementation - Implement Date Was the plan written and implemented per the requirement of 192.1015 by 08/02/2011? (LPGIM.QA.PLANIMPLEMENT.P) 192.1015(a)

Small LPG Distribution Integrity Management - Knowledge of the System

- **1. System Knowledge Information Considered** Does the plan include an explanation of the mechanisms or procedures to address how the operator will demonstrate knowledge of its pipeline which, to the extent known, should include the approximate location and material of its pipeline? (LPGIM.RA.INFORMATION.P) 192.1015(b)(1)
- **2. System Knowledge Gaps** Does the plan include an explanation of the mechanisms or procedures to identify additional information that is needed to fill gaps due to missing, inaccurate, or incomplete records? (LPGIM.RA.GAPS.P) 192.1015(b)(1)
- **3. System Knowledge Information Needed** Do the written mechanisms or procedures specify the means to collect the additional information over time through normal activities conducted on the pipeline (e.g. design, construction, operations or maintenance activities)? (LPGIM.RA.INFONEEDS.P) 192.1015(b)(1)
- **4. System Knowledge Information Needed** Does the plan list the additional information needed to fill gaps due to missing, inaccurate, or incomplete records? (LPGIM.RA.INFONEEDS.R) 192.1015(b)(1)
- **5. System Knowledge New Pipe Data** Do the written mechanisms or procedures require the capture and retention of data on any new pipeline installed? (LPGIM.RA.NEWPIPEDATA.P) 192.1015(c)(3)
- **6. System Knowledge New Pipe Data** Does the captured and retained data on any new pipeline include, at a minimum, the location where the new pipeline is installed and the material from which it is constructed? (LPGIM.RA.NEWPIPEDATA.R) 192.1015(c)(3)

GD.2024.01 Page 54 of 85

7. System Knowledge - Understanding Has the operator demonstrated an adequate understanding of the system,
which, to the extent known, should include the approximate location and material of its pipelines?
(LPGIM.RA.DEMOUNDERSTANDING.R) 192.1015(b)(1)

Small LPG Distribution Integrity Management - Identify Threats

- **1. Identify Threats Information Considered** Did the operator consider the information that was reasonably available to identify existing and potential threats? (LPGIM.RA.INFOCONSIDERED.R) 192.1015(b)(2)
- **2. Identify Threats Threats Considered** In identifying threats, do the written mechanisms or procedures include consideration of all of the required categories of threats to each gas distribution pipeline? (LPGIM.RA.THREATCATEGORIES.P) 192.1015(b)(2)
- **3. Identify Threats Implementation** Do records demonstrate implementation of the element "Identify Threats"? (LPGIM.RA.IMPLEMENTTH.R) 192.1015(b)(2)

Small LPG Distribution Integrity Management - Evaluate and Rank Risk

- **1. Rank Risk Methodology** Do the written mechanisms or procedures contain the method(s) and/or a model used to determine the relative importance of each threat and estimate and rank the risks posed? (LPGIM.RA.RISKRANKING.P) 192.1015(b)(3)
- **2. Rank Risk Validation** Were the results generated by the risk evaluation model/method validated? (LPGIM.RA.RESULTSVALIDATION.R) 192.1015(b)(3)
- **3. Rank Risk Implementation** Do records demonstrate implementation of the element "Evaluate and Rank Risk"? (LPGIM.RA.IMPLEMENTRR.R) 192.1015(b)(3)

GD.2024.01 Page 55 of 85

Small LPG Distribution Integrity Management - Preventive and Mitigative Actions

- **1. Measures to Reduce Risk Identification** Do the written mechanisms or procedures identify when measures, beyond minimum code requirements specified outside of Part 192 Subpart P, are required to reduce risk? (LPGIM.PM.IDENTIFYMEASURES.P) 192.1015(b)(4)
- **2. Measures to Reduce Risk Identification** When measures, beyond minimum code requirements specified outside of Part 192 Subpart P, are required to reduce risk, does the plan identify the measures selected, how they will be implemented, and the risks they are addressing? (LPGIM.PM.IDENTIFYMEASURES.R) 192.1015(b)(4)
- **3. Measures to Reduce Risk Implementation** Do records demonstrate implementation of those measures to reduce risk required by Part 192 Subpart P? (LPGIM.PM.IMPLEMENTPM.R) 192.1015(b)(4)

Small LPG Distribution Integrity Management - Measure Performance and Evaluate Effectiveness

- **1. Measure Performance Monitoring** Does the plan contain written mechanisms or procedures for how the operator monitors the performance measure "number of leaks eliminated or repaired on its pipeline and their causes"? (LPGIM.QA.PERFMEASUREMONITOR.P) 192.1015(b)(5)
- **2. Measure Performance Implementation** Did the operator monitor the performance measure "number of leaks eliminated or repaired on its pipeline and their causes"? (LPGIM.QA.PERFMEASUREMONITOR.R) 192.1015(b)(5)

Small LPG Distribution Integrity Management - Periodic Evaluation

1. Periodic Evaluation - Evaluation Period Do the written mechanisms or procedures provide for determination of the appropriate period for conducting IM program evaluations based on the complexity of its pipeline and changes in factors affecting the risk of failure, not to exceed 5 years? (LPGIM.CA.EVALUATIONPERIOD.P) 192.1015(b)(6)

GD.2024.01 Page 56 of 85

2. Periodic Evaluation - Performance Monitoring Do the written mechanisms or procedures consider the result	S
of the performance monitoring in the periodic IM program evaluation? (LPGIM.CA.PERIODICEVALUATION.P) 192.1015(b)(6)	
(192.1015(b)(5))	

3. Periodic Evaluation -	Implementation Do records demonstrate implementation of the element "Periodic
Evaluation and Improvement"? (LPGIM.CA.PERIODICEVALUATION.R) 192.1015(b)(6) (192.1015(b)(5))

Small LPG Distribution Integrity Management - Records Required to be Kept

- **1. Records IM Plans** Are there written mechanisms or procedures specifying that a written IM plan in accordance with 192.1015, including superseded IM plans, will be maintained for at least 10 years? (LPGIM.QA.PLANRETENTION.P) 192.1015(c)(1)
- **2. Records Requirements** Are there written mechanisms or procedures specifying that documents demonstrating compliance to support threat identification will be maintained for at least 10 years? (LPGIM.QA.THREATIDRECORDS.P) 192.1015(c)(2)
- **3. Records System Records** Are there written mechanisms or procedures specifying that documentation will be maintained for at least 10 years showing the location and material of all pipe and appurtenances that are installed after the effective date of the operator's IM program and, to the extent known, the location and material of all pipe and appurtenances that were existing on the effective date of the operator's program? (LPGIM.QA.SYSTEMRECORDS.P) 192.1015(c)(3)
- **4. Records Implementation** Has the operator maintained the required records? (LPGIM.QA.RECORDREQUIREMENTS.R) 192.1015(c)

Public Awareness and Damage Prevention - Damage Prevention

1. Damage Prevention Program *Is a damage prevention program approved and in place?* (PD.DP.PDPROGRAM.P) 192.614(a)

GD.2024.01 Page 57 of 85

2. Participation in Qualified One Call Systems Does the process require participation in qualified one-call systems? (PD.DP.ONECALL.P) 192.614(b)
3. Construction Marking Does the process require marking proposed excavation sites to the Common Ground Alliance's (CGA) Best Practices or the use of more stringent and accurate requirements? (PD.DP.EXCAVATEMARK.P) 192.614(c)(5)
4. Documented Damage Prevention Program - TPD Does the process specify how reports of Third-Party Activit and names of associated contractors or excavators are input back into the mail-outs and communications with excavators along the system? (PD.DP.TPD.P) 192.614(c)(1)
5. Documented Damage Prevention Program - TPD/One Call Does the process specify how reports of TPD are checked against One-Call tickets? (PD.DP.TPDONECALL.P) 192.614(c)(3)
6. Participation in Qualified One Call Systems Observe operator process a "One Call" ticket. (PD.DP.ONECALL.O) 192.614(c)(3)
7. Damage Prevention Program Does the damage prevention program meet minimum requirements specified in 192.614(c)? (PD.DP.PDPROGRAM.R) 192.614(c)
Public Awareness and Damage Prevention - Public Awareness
1. Public Education Program Has the continuing public education (awareness) program been established as required? (PD.PA.PROGRAM.P) 192.616(a) (192.616(h))
2. Management Support of Public Awareness Program Does the operator's program documentation demonstrate management support? (PD.PA.MGMTSUPPORT.P) 192.616(a) (API RP 1162 Section 2.5;API RP 1162 Section 7.1)

GD.2024.01 Page 58 of 85

3. Asset Identification Does the program clearly identify the specific pipeline systems and facilities to be included in the program, along with the unique attributes and characteristics of each? (PD.PA.ASSETS.P) 192.616(b) (API RP 1162 Section 2.7 Step 4)
4. Audience Identification Does the program establish methods to identify the individual stakeholders in the four affected stakeholder audience groups: (1) affected public, (2) emergency officials, (3) local public officials, and (4) excavators, as well as affected municipalities, school districts, businesses, and residents? (PD.PA.AUDIENCEID.P) 192.616(d) (192.616(e);192.616(f);API RP 1162 Section 2.2;API RP 1162 Section 3)
5. Audience Identification Do records identify the individual stakeholders in the four affected stakeholder audience groups: (1) affected public, (2) emergency officials, (3) local public officials, and (4) excavators, as well as affected municipalities school districts, businesses, and residents to which it sends public awareness materials and messages? (PD.PA.AUDIENCEID.R) 192.616(d) (192.616(e);192.616(f);API RP 1162 Section 2.2;API RP 1162 Section 3)
6. Messages, Delivery Methods, and Frequencies Does the program define the combination of messages, delivery methods, and delivery frequencies to comprehensively reach all affected stakeholder audiences in all areas where gas is transported? (PD.PA.MESSAGES.P) 192.616(c) (API RP 1162 Section 3;API RP 1162 Section 4;API RP 1162 Section 5)
7. Consideration of Supplemental Enhancements Were relevant factors considered to determine the need for supplemental public awareness program enhancements for each stakeholder audience, as described in API RP 1162? (PD.PA.SUPPLEMENTAL.P) 192.616(c) (API RP 1162 Section 6.2)
8. Educational Provisions Did delivered messages specifically include provisions to educate the public, emergency officials, local public officials, and excavators on: (1) Use of a one-call notification system prior to excavation and other damage prevention activities; (2) Possible hazards associated with unintended releases from a gas pipeline facility; (3) Physical indications of a possible release; (4) Steps to be taken for public safety in the event of a gas pipeline release; and (5) Procedures to report such an event? (PD.PA.EDUCATE.R) 192.616(d) (192.616(f))
9. Messages on Pipeline Facility Locations <i>Were messages developed and delivered to advise affected municipalities, school districts, businesses, and residents of pipeline facility locations?</i> (PD.PA.LOCATIONMESSAGE.R) 192.616(e) (192.616(f))

10. Baseline Message Delivery Frequency Did the delivery of materials and messages meet or exceed the baseline delivery frequencies specified in API RP 1162, Table 2-1 through Table 2.3? (PD.PA.MESSAGEFREQUENCY.R) 192.616(c) (API RP 1162 Table 2-1; API RP 1162 Table 2-2; API RP 1162 Table 2-3)

GD.2024.01 Page 59 of 85

11. Liaison with Public Officials Do records indicate liaisons established and maintained with appropriate fire, police, other public officials, and 911 emergency call centers in accordance with procedures? (EP.ERG.LIAISON.R) 192.603(b) (192.615(c)(1);192.615(c)(2);192.615(c)(3);192.615(c)(4);192.616(c);ADB-2005-03)

Note: this question is presented in multiple places so you will see multiple instances of it on this report.

- **12. Other Languages** Does the program require that materials and messages be provided in other languages commonly understood by a significant number and concentration of non-English speaking populations in the operator's areas? (PD.PA.LANGUAGE.P) 192.616(g) (API RP 1162 Section 2.3.1)
- **13. Other Languages** Were materials and messages developed and delivered in other languages commonly understood by a significant number and concentration of non-English speaking populations in the operator's areas? (PD.PA.LANGUAGE.R) 192.616(g) (API RP 1162 Section 2.3.1)
- **14. Evaluation Plan** Does the program include a process that specifies how program implementation and effectiveness will be periodically evaluated? (PD.PA.EVALPLAN.P) 192.616(i) (192.616(c); API RP 1162 Section 8; API RP 1162 Appendix E)
- **15. Evaluate Program Implementation** Has an audit or review of the operator's program implementation been performed annually since the program was developed? (PD.PA.EVALIMPL.R) 192.616(c) (192.616(i); API RP 1162 Section 8.3)
- **16. Acceptable Methods for Program Implementation Audits** *Was one or more of the three acceptable methods (i.e., internal assessment, 3rd-party contractor review, or regulatory inspections) used to complete the annual audit or review of program implementation?* (PD.PA.AUDITMETHODS.R) 192.616(c) (192.616(i);API RP 1162 Section 8.3)
- **17. Program Changes and Improvements** Were changes made to improve the program and/or the implementation process based on the results and findings of the annual audit(s)? (PD.PA.PROGRAMIMPROVE.R) 192.616(c) (API RP 1162 Section 8.3)
- **18. Evaluating Program Effectiveness** Do records indicate program effectiveness evaluation(s) have been performed and cover all program requirements and all systems covered by the program? (PD.PA.EVALEFFECTIVENESS.R) 192.616(c) (API RP 1162 Section 8.4)

GD.2024.01 Page 60 of 85

19. Measure Program Outreach <i>In evaluating effectiveness, was actual program outreach for each stakeholder audience tracked?</i> (PD.PA.MEASUREOUTREACH.R) 192.616(c) (API RP 1162 Section 8.4.1)
20. Measure Understandability of Message Content In evaluating program effectiveness, was the percentage of each stakeholder audience that understood and retained the key information from the messages determined? (PD.PA.MEASUREUNDERSTANDABILITY.R) 192.616(c) (API RP 1162 Section 8.4.2)
21. Measure Desired Stakeholder Behavior In evaluating program effectiveness, was evaluation made of whether appropriate preventive, response, and mitigative behaviors were understood and likely to be exhibited? (PD.PA.MEASUREBEHAVIOR.R) 192.616(c) (API RP 1162 Section 8.4.3)
22. Measure Bottom-Line Results Were bottom-line results of the program measured by tracking third-party incidents and consequences including: (1) near misses, (2) excavation damages resulting in pipeline failures, (3) excavation damages that do not result in pipeline failures? (PD.PA.MEASUREBOTTOM.R) 192.616(c) (API RP 1162 Section 8.4.4)
23. Program Changes Were needed changes and/or modifications to the program identified and documented based on the results and findings of the program effectiveness evaluations? (PD.PA.CHANGES.R) 192.616(c) (API RP 1162 Section 2.7 (Step 12);API RP 1162 Section 8.5)
24. Master Meter and Petroleum Gas Systems Does the public awareness program for a master meter or petroleum gas system meet the requirements of Part 192? (PD.PA.MSTRMETER.P) 192.616(j) (192.616(h))
25. Master Meter and Petroleum Gas Systems Do records indicate the public awareness program for a master meter or petroleum gas system operator has met the requirements of Part 192? (PD.PA.MSTRMETER.R) 192.616(j) (192.616(h); API RP 1162 Section 2.7 (Step 12); API RP 1162 Section 8.5)

GD.2024.01 Page 61 of 85

Public Awareness and Damage Prevention - ROW Markers, Patrols, Leakage Survey and Monitoring

1. Continuing Surveillance Are there processes for performing continuing surveillance of pipeline facilities, and also for reconditioning, phasing out, or reducing the MAOP in a pipeline segment that is determined to be in unsatisfactory condition but on which no immediate hazard exists? (MO.GO.CONTSURVEILLANCE.P) 192.605(e) (192.613(a);192.613(b);192.703(b);192.703(c)) Note: this question is presented in multiple places so you will see multiple instances of it on this report.

2. Continuing Surveillance Do records indicate performance of continuing surveillance of facilities as required, and also the reconditioning, phasing out, or MAOP reduction in any pipeline segment that was determined to be in unsatisfactory condition but on which no immediate hazard existed? (MO.GO.CONTSURVEILLANCE.R) 192.605(b)(3) (192.613(a);192.613(b);192.703(b);192.703(c))

Note: this question is presented in multiple places so you will see multiple instances of it on this report.

3. Continuing Surveillance Are unsatisfactory conditions being captured and addressed by continuing surveillance of facilities and the pipeline as required by 192.613? (MO.GO.CONTSURVEILLANCE.O) 192.605(b)(3) (192.613(b);192.703(a);192.703(b);192.703(c))

Note: this question is presented in multiple places so you will see multiple instances of it on this report.

Reporting - Regulatory Reporting (Traditional)

- **1. Annual Report Records** Have complete and accurate Annual Reports been submitted? (RPT.RR.ANNUALREPORT.R) 191.11(a)
- **2. Immediate Reporting: Incidents** *Is there a process to immediately report incidents to the National Response Center?* (RPT.RR.IMMEDREPORT.P) 191.5(b) (191.7(a);191.7(d))
- **3. Immediate Reporting: Incidents** Do records indicate immediate notifications of incidents were made in accordance with 191.5? (RPT.RR.IMMEDREPORT.R) 191.5(a) (191.7(d))

GD.2024.01 Page 62 of 85

4. Incident Reports Does the process require preparation and filing of an incident report as soon as practicable but no later than 30 days after discovery of a reportable incident? (RPT.RR.INCIDENTREPORT.P) 191.9(a)
5. Supplemental Incident Reports Does the process require preparation and filing of supplemental incident reports? (RPT.RR.INCIDENTREPORTSUPP.P) 191.9(b)
6. Incident Reports Do records indicate reportable incidents were identified and reports were submitted to DOT on Form 7100.1 within the required time frame? (RPT.RR.INCIDENTREPORT.R) 191.9(a)
7. Supplemental Incident Reports Do records indicate accurate supplemental incident reports were filed and within the required timeframe? (RPT.RR.INCIDENTREPORTSUPP.R) 191.9(b)
8. Safety Related Condition Reports Do the procedures require reporting of safety-related conditions? (RPT.RR.SRCR.P) 192.605(a) (191.23(a);191.23(b);191.25(a);191.25(c))
9. Safety Related Condition Reports Do records indicate safety-related condition reports were filed as required? (RPT.RR.SRCR.R) 191.23(a) (191.23(b);191.25(a);191.25(c))
10. National Registry of Pipeline and LNG Operators (OPID) Does the process require the obtaining, and appropriate control, of Operator Identification Numbers (OPIDs), including changes in entity, acquisition/divestiture, and construction/update/uprate? (RPT.RR.OPID.P) 191.22(a) (191.22(c);191.22(d))
11. National Registry of Pipeline and LNG Operators (OPID) Do records indicate appropriate control of Operator Identification Numbers (OPIDs), including changes in entity, acquisition/divestiture, and construction/update/uprate, and the National Registry of Pipeline and LNG Operators has been notified of applicable changes? (RPT.RR.OPID.R) 191.22(a) (191.22(c);191.22(d))

GD.2024.01 Page 63 of 85

Time-Dependent Threats - Atmospheric Corrosion

1. Atmospheric Corrosion Does the process give adequate guidance identifying atmospheric corrosion and for protecting above ground pipe from atmospheric corrosion? (TD.ATM.ATMCORRODE.P) 192.605(b)(2) (192.479(a);192.479(b);192.479(c))
2. Atmospheric Corrosion <i>Do records document the protection of above ground pipe from atmospheric corrosion?</i> (TD.ATM.ATMCORRODE.R) 192.491(c) (192.479(a);192.479(b);192.479(c))
3. Atmospheric Corrosion Monitoring Does the process give adequate instruction for the inspection of aboveground pipeline segments, including inside meter and pressure regulator installations, for atmospheric corrosion? (TD.ATM.ATMCORRODEINSP.P) 192.605(b)(2) (192.481(a);192.481(b);192.481(c);192.481(d))
4. Atmospheric Corrosion Monitoring Do records document inspection of aboveground pipe for atmospheric corrosion? (TD.ATM.ATMCORRODEINSP.R) 192.491(c) (192.481(a);192.481(b);192.481(c);192.481(d))
5. Atmospheric Corrosion Monitoring <i>Do field observations indicate that pipe exposed to atmospheric corrosion is properly coated?</i> (TD.ATM.ATMCORRODEINSP.O) 192.481(b) (192.481(c);192.479(a);192.479(b);192.479(c);192.481(d))
Time-Dependent Threats - External Corrosion - CP Monitoring
1. Cathodic Protection Monitoring Criteria Does the process require CP monitoring criteria to be used that is acceptable? (TD.CPMONITOR.MONITORCRITERIA.P) 192.605(b)(2) (192.463(a);192.463(c))
2. Cathodic Protection Monitoring Criteria Do records document that the CP monitoring criteria used was acceptable? (TD.CPMONITOR.MONITORCRITERIA.R) 192.491(c) (192.463(a))
3. Cathodic Protection Monitoring Criteria Are methods used for taking CP monitoring readings that allow for the application of appropriate CP monitoring criteria? (TD.CPMONITOR.MONITORCRITERIA.O) 192.465(a) (192.463(b);192.463(c);192.463(a))

GD.2024.01 Page 64 of 85

4. Cathodic Protection Monitoring Does the process adequately describe how to monitor CP that has been applied to pipelines? (TD.CPMONITOR.TEST.P) 192.605(b)(2) (192.465(a))
5. Cathodic Protection Monitoring <i>Do records adequately document cathodic protection monitoring tests have occurred as required?</i> (TD.CPMONITOR.TEST.R) 192.491(c) (192.465(a))
6. Rectifiers or other Impressed Current Sources Does the process give sufficient details for making electrical checks of rectifiers or impressed current sources? (TD.CPMONITOR.CURRENTTEST.P) 192.605(b)(2) (192.465(b))
7. Rectifier or other Impressed Current Sources <i>Do records document details of electrical checks of sources of rectifiers or other impressed current sources?</i> (TD.CPMONITOR.CURRENTTEST.R) 192.491(c) (192.465(b))
8. Rectifier or other Impressed Current Sources <i>Do field observations confirm impressed current sources are properly maintained and are functioning properly?</i> (TD.CPMONITOR.CURRENTTEST.O) 192.465(b)
9. Bonds, Diodes and Reverse Current Switches Does the process give sufficient details for making electrical checks of interference bonds, diodes, and reverse current switches? (TD.CPMONITOR.REVCURRENTTEST.P) 192.605(b)(2) (192.465(c))
10. Bonds, Diodes and Reverse Current Switches <i>Do records document details of electrical checks interference bonds, diodes, and reverse current switches?</i> (TD.CPMONITOR.REVCURRENTTEST.R) 192.491(c) (192.465(c))
11. Bonds, Diodes and Reverse Current Switches Are interference bonds, diodes, and reverse current switches properly maintained and are they functioning properly? (TD.CPMONITOR.REVCURRENTTEST.O) 192.465(c)
12. Correction of Corrosion Control Deficiencies Does the process require that the operator promptly correct any identified deficiencies in corrosion control? (TD.CPMONITOR.DEFICIENCY.P) 192.605(b)(2) (192.465(d))

GD.2024.01 Page 65 of 85

13. Correction of Corrosion Control Deficiencies <i>Do records adequately document actions taken to correct any identified deficiencies in corrosion control?</i> (TD.CPMONITOR.DEFICIENCY.R) 192.491(c) (192.465(d))
14. Test Stations Does the process contain provisions to assure that each pipeline has sufficient test stations or other contact points to determine the adequacy of cathodic protection? (TD.CPMONITOR.TESTSTATION.P) 192.469
15. Test Stations Do records identify the location of test stations and show a sufficient number of test stations? (TD.CPMONITOR.TESTSTATION.R) 192.469
16. Test Stations Do cathodically protected pipelines have a sufficient number of test stations? (TD.CPMONITOR.TESTSTATION.O) 192.469
17. Test Leads Does the process provide adequate instructions for the installation of test leads? (TD.CPMONITOR.TESTLEAD.P) 192.605(b)(2) (192.471(a);192.471(b);192.471(c))
18. Test Leads Do records document that pipelines with cathodic protection have electrical test leads installed in accordance with requirements of Subpart I? (TD.CPMONITOR.TESTLEAD.R) 192.491(c) (192.471(a);192.471(b);192.471(c))
19. Test Leads Do pipelines with cathodic protection have electrical test leads installed in accordance with requirements of Subpart I? (TD.CPMONITOR.TESTLEAD.O) 192.471(a)
20. Interference Currents Does the operator have a program in place to minimize detrimental effects of interference currents on its pipeline system and does the process for designing and installing cathodic protection systems provide for the minimization of detrimental effects of interference currents on existing adjacent metallic structures? (TD.CPMONITOR.INTFRCURRENT.P) 192.605(b)(2) (192.473(a))
21. Interference Currents Do records document an effective program is in place to minimize detrimental effects of interference currents and that detrimental effects of interference currents from CP systems on other underground metallic structures are minimized? (TD.CPMONITOR.INTFRCURRENT.R) 192.491(c) (192.473(a))

GD.2024.01 Page 66 of 85

- **22. Interference Currents** Are areas of potential stray current identified, and if found, the detrimental effects of stray currents minimized? (TD.CPMONITOR.INTFRCURRENT.O) 192.473(a)
- **23. Corrosion Control Records** Does the process include records requirements for the corrosion control activities listed in §192.491? (TD.CP.RECORDS.P) 192.605(b)(2) (192.491(a);192.491(b);192.491(c))

Note: this question is presented in multiple places so you will see multiple instances of it on this report.

24. Corrosion Control Records Do records indicate the location of all corrosion control items listed in §192.491(a)? (TD.CP.RECORDS.R) 192.491(a) (192.491(b);192.491(c))

Note: this question is presented in multiple places so you will see multiple instances of it on this report.

Time-Dependent Threats - External Corrosion - Cathodic Protection

- **1. Cathodic Protection post-July 1971** Does the process require that each buried or submerged pipeline installed after July 31, 1971, be protected against external corrosion with a cathodic protection system within 1 year after completion of construction, conversion to service, or becoming jurisdictional onshore gathering? (TD.CP.POST1971.P) 192.605(b)(2) (192.455(a);192.457(a);192.452(a);192.452(b);192.455(c);192.455(d);192.455(g))
- **2. Cathodic Protection post-July 1971** Do records document that each buried or submerged pipeline installed after July 31, 1971, has been protected against external corrosion with a cathodic protection system within 1 year after completion of construction, conversion to service, or becoming jurisdictional onshore gathering? (TD.CP.POST1971.R) 192.491(c) (192.455(a);192.457(a);192.452(a);192.455(b);192.455(f);192.455(g))
- **3. Cathodic Protection pre-August 1971** Does the process require that pipelines installed before August 1, 1971 (except for cast and ductile iron lines) which are 1) bare or ineffectively coated transmission lines, or 2) bare or coated pipes in compressor, regulator or meter stations, or 3) bare or coated distribution lines, must be cathodically protected in areas where active corrosion is found? (TD.CP.PRE1971.P) 192.605(b)(2) (192.457(b))
- **4. Use of Aluminum** Does the process give adequate guidance for the installation of aluminum in a submerged or buried pipeline? (TD.CP.ALUMINUM.P) 192.605(b)(2) (192.455(e))

GD.2024.01 Page 67 of 85

5. Use of Aluminum Do records support the installation of aluminum when it was installed in a submerged or buried pipeline? (TD.CP.ALUMINUM.R) 192.491(c) (192.455(e))
6. Cathodic Protection of Amphoteric Metals Does the process describe criteria to be used for cathodic protection of amphoteric metals (aluminum) that are included in a steel pipeline? (TD.CP.AMPHOTERIC.P) 192.605(b)(2) (192.463(b);192.463(c))
7. Cathodic Protection of Amphoteric Metals Do records document adequate cathodic protection of amphoteric metals (aluminum) that are included in a steel pipeline? (TD.CP.AMPHOTERIC.R) 192.491(c) (192.463(b))
8. Unprotected Buried Pipelines (typically bare pipelines) Does the process give sufficient direction for the monitoring of external corrosion on buried pipelines that are not protected by cathodic protection? (TD.CP.UNPROTECT.P) 192.605(b)(2) (192.465(e))
9. Unprotected Buried Pipelines (typically bare pipelines) Do records adequately document that exposed buried piping was examined for corrosion and deteriorated coating? (TD.CP.UNPROTECT.R) 192.491(c) (192.465(e))
10. Isolation from Other Metallic Structures Does the process give adequate guidance for electrically isolating each buried or submerged pipeline from other metallic structures unless they electrically interconnect and cathodically protect the pipeline and the other structures as a single unit? (TD.CP.ELECISOLATE.P) 192.605(b)(2) (192.467(a);192.467(b);192.467(d);192.467(e))
11. Isolation from Other Metallic Structures Do records adequately document electrical isolation of each buried or submerged pipeline from other metallic structures unless they electrically interconnect and cathodically protect the pipeline and the other structures as a single unit? (TD.CP.ELECISOLATE.R) 192.491(c) (192.467(a);192.467(b);192.467(c);192.467(d);192.467(e))
12. Isolation from Other Metallic Structures Are measures performed to ensure electrical isolation of each buried or submerged pipeline from other metallic structures unless they electrically interconnect and cathodically protect the pipeline and the other structures as a single unit? (TD.CP.ELECISOLATE.O) 192.467(a) (192.467(b);192.467(c);192.467(d);192.467(e))
13. Inspection/Testing to Ensure Electrical Isolation Does the process provide adequate guidance to inspect and electrically test to ensure that electrical isolation is adequate? (TD.CP.ELECISOLATETEST.P) 192.605(b)(2) (192.467(d))

GD.2024.01 Page 68 of 85

14. Inspection/Testing to Ensure Electrical Isolation <i>Do records adequately document the inspection and electrical testing performed to ensure that electrical isolation is adequate?</i> (TD.CP.ELECISOLATETEST.R) 192.491(c) (192.467(d))
15. Inspection/Testing to Ensure Electrical Isolation <i>Do field observations verify that inspection and electrical testing ensured that electrical isolation is adequate?</i> (TD.CP.ELECISOLATETEST.O) 192.467(d)
16. Graphitization of Cast Iron and Ductile Iron Does the process give adequate guidance for remediation of graphitization of cast iron or ductile iron pipe? (TD.CP.GRAPHITIZE.P) 192.605(b)(2) (192.489(a);192.489(b))
17. Graphitization of Cast Iron and Ductile Iron <i>Do records document remediation of graphitization of cast iron or ductile iron pipe?</i> (TD.CP.GRAPHITIZE.R) 192.491(c) (192.489(a);192.489(b))
18. Graphitization of Cast Iron and Ductile Iron Has there been adequate remediation for the graphitization of cast iron or ductile iron pipe? (TD.CP.GRAPHITIZE.O) 192.489(a) (192.489(b))
19. Corrosion Control Records Does the process include records requirements for the corrosion control activities listed in §192.491? (TD.CP.RECORDS.P) 192.605(b)(2) (192.491(a);192.491(b);192.491(c)) Note: this question is presented in multiple places so you will see multiple instances of it on this report.

20. Corrosion Control Records Do records indicate the location of all corrosion control items listed in §192.491(a)? (TD.CP.RECORDS.R) 192.491(a) (192.491(b);192.491(c))

Note: this question is presented in multiple places so you will see multiple instances of it on this report.

Time-Dependent Threats - External Corrosion - Coatings

1. New Buried Pipe Coating Does the process require that each buried or submerged pipeline installed after July 31, 1971 be externally coated with a material that is adequate for underground service on a cathodically protected pipeline? (TD.COAT.NEWPIPE.P) 192.605(b)(2) (192.455(a);192.455(b);192.455(d);192.455(d);192.461(a);192.461(b);192.463;192.483(a))

GD.2024.01 Page 69 of 85

2. New Buried Pipe Coating Do records document that each buried or submerged pipeline installed after July 31, 1971 has been externally coated with a suitable coating material? (TD.COAT.NEWPIPE.R) 192.491(c) (192.455(a);192.461(b);192.483(a))
3. New Buried Pipe Coating Installation Does the process give adequate guidance for the application and inspection of protective coatings on pipe? (TD.COAT.NEWPIPEINSTALL.P) 192.605(b)(2) (192.461(c);192.461(d);192.461(e);192.483(a))
4. New Buried Pipe Coating Application <i>Do records document that coatings are applied as required by procedures?</i> (TD.COAT.NEWPIPEINSTALL.R) 192.461(a) (192.461(c))
5. New Buried Pipe Coating Installation <i>Is external protective coating being protected from damage that could result from adverse ditch conditions or supporting blocks?</i> (TD.COAT.NEWPIPEINSTALL.O) 192.461(d)
6. Conversion to Service - Pipe Coating Does the process require that each buried or submerged pipeline that has been converted to gas service and was installed after July 31, 1971, be protected against external corrosion with an adequate coating unless exempted by 192.455(b)? (TD.COAT.CONVERTPIPE.P) 192.605(b)(2) (192.452(a);192.455(a);192.455(b);192.455(d);192.455(d);192.461(a))
Time-Dependent Threats - External Corrosion - Exposed Pipe
1. Examination of Exposed Portions of Buried Pipe Does the process require that exposed portions of buried pipeline must be examined for external corrosion? (TD.CPEXPOSED.EXPOSEINSPECT.P) 192.605(b)(2) (192.459)
2. Examination of Exposed Portions of Buried Pipe <i>Do records adequately document that exposed buried piping was examined for corrosion?</i> (TD.CPEXPOSED.EXPOSEINSPECT.R) 192.491(c) (192.459)
3. Examination of Exposed Portions of Buried Pipe <i>Is exposed buried piping examined for corrosion and deteriorated coating?</i> (TD.CPEXPOSED.EXPOSEINSPECT.O) 192.459

GD.2024.01 Page 70 of 85

4. Evaluation of Externally Corroded Pipe Does the process provide sufficient direction for personnel to evaluate the remaining strength of externally corroded pipe? (TD.CPEXPOSED.EXTCORRODEEVAL.P) 192.605(b)(2) (192.487;192.489)
5. Evaluation of Externally Corroded Pipe <i>Do records adequately document the evaluation of externally corroded pipe?</i> (TD.CPEXPOSED.EXTCORRODEEVAL.R) 192.491(c) (192.487;192.489)
6. Evaluation of Externally Corroded Pipe <i>Do field observations verify that externally corroded pipe was adequatel evaluated?</i> (TD.CPEXPOSED.EXTCORRODEEVAL.O) 192.487 (192.489)
7. Repair of Externally Corroded Pipe Does the process give sufficient guidance for personnel to repair or replace pipe that is externally corroded to an extent that there is not sufficient remaining strength in the pipe wall? (TD.CPEXPOSED.EXTCORRODREPAIR.P) 192.605(b)(2) (192.487;192.489)
8. Repair of Externally Corroded Pipe Do records document the repair or replacement of pipe that has been externally corroded to an extent that there is not sufficient remaining pipe wall strength? (TD.CPEXPOSED.EXTCORRODREPAIR.R) 192.491(c) (192.487;192.489)
9. Repair of Externally Corroded Pipe Do records document the repair or replacement of pipe that has been externally corroded to an extent that there is not sufficient remaining pipe wall strength? (TD.CPEXPOSED.EXTCORRODREPAIR.O) 192.487 (192.489)
10. Corrosion Control Records Does the process include records requirements for the corrosion control activities listed in §192.491? (TD.CP.RECORDS.P) 192.605(b)(2) (192.491(a);192.491(b);192.491(c)) Note: this question is presented in multiple places so you will see multiple instances of it on this report.
11. Corrosion Control Records Do records indicate the location of all corrosion control items listed in §192.491(a)? (TD.CP.RECORDS.R) 192.491(a) (192.491(b);192.491(c)) Note: this question is presented in multiple places so you will see multiple instances of it on this report.

GD.2024.01 Page 71 of 85

Time-Dependent Threats - Internal Corrosion - Preventive Measures

1. Internal Corrosion Does the process require that the corrosive effect of the gas in the pipeline be investigated and if determined to be corrosive, steps be taken to minimize internal corrosion? (TD.ICP.CORRGAS.P) 192.605(b)(2) (192.475(a))
2. Internal Corrosion Do the records demonstrate that the corrosive effect of the gas in the pipeline has been investigated and if determined to be corrosive, steps be taken to minimize internal corrosion? (TD.ICP.CORRGAS.R) 192.491(c) (192.475(a))
3. Internal Corrosive Gas Prevention <i>If the transportation of corrosive gas is not allowed, is the transportation of corrosive gas prevented?</i> (TD.ICP.CORRGASPRVNT.O) 192.475(a)
4. Internal Corrosion Corrosive Gas Actions Does the process give adequate direction for actions to be taken if corrosive gas is being transported by pipeline? (TD.ICP.CORRGASACTION.P) 192.605(b)(2) (192.477)
5. Internal Corrosive Gas Actions Do records document the actions taken when corrosive gas is being transported by pipeline? (TD.ICP.CORRGASACTION.R) 192.491(c) (192.477)
6. Internal Corrosion Corrosive Gas Actions Are adequate actions taken when corrosive gas is being transported by pipeline? (TD.ICP.CORRGASACTION.O) 192.477
7. Internal Corrosion in Cutout Pipe Does the process direct personnel to examine removed pipe for evidence of internal corrosion? (TD.ICP.EXAMINE.P) 192.605(b)(2) (192.475(a);192.475(b))
8. Internal Corrosion in Cutout Pipe Do records document examination of removed pipe for evidence of internal corrosion? (TD.ICP.EXAMINE.R) 192.491(c) (192.475(a);192.475(b))
9. Evaluation of Internally Corroded Pipe Does the process give sufficient guidance for personnel to evaluate the remaining strength of pipe that has been internally corroded? (TD.ICP.EVALUATE.P) 192.605(b)(2) (192.487)

GD.2024.01 Page 72 of 85

10. Evaluation of Internally Corroded Pipe Do records document adequate evaluation of internally corroded pipe? (TD.ICP.EVALUATE.R) 192.491(c) (192.487)
11. Repair of Internally Corroded Pipe Does the process give sufficient guidance for personnel to repair or replace pipe that has internally corroded to an extent that there is no longer sufficient remaining strength in the pipe wall? (TD.ICP.REPAIRINT.P) 192.605(b)(2) (192.487(a);192.487(b);192.489(a);192.489(b);192.491(c))
12. Repair of Internally Corroded Pipe Do records document the repair or replacement of pipe that has been internally corroded to an extent that there is not sufficient remaining strength in the pipe wall? (TD.ICP.REPAIRINT.R) 192.491(c) (192.487;192.489)
13. Repair of Internally Corroded Pipe Do field observations confirm repair or replacement of pipe that has been internally corroded to an extent that there is not sufficient remaining strength in the pipe wall? (TD.ICP.REPAIRINT.O) 192.487 (192.489)
14. Bottle Type and Pipe Type Holders Does the process preclude storing gas containing more than 0.25 grain of hydrogen sulfide per 100 standard cubic feet (5.8 milligrams/m3) at standard conditions (4 parts per million) in pipe-type or bottle-type holders? (TD.ICP.PIPEBOTTLE.P) 192.605(b)(2) (192.475(c))
15. Bottle Type and Pipe Type Holders Do the records indicate gas was not stored that contained more than 0.25 grain of hydrogen sulfide per 100 standard cubic feet (5.8 milligrams/m3) at standard conditions (4 parts per million) in pipe-type or bottle-type holders? (TD.ICP.PIPEBOTTLE.R) 192.491(c) (192.475(c))
16. Bottle Type and Pipe Type Holders Is gas containing more than 0.25 grain of hydrogen sulfide per 100 standard cubic feet (5.8 milligrams/m3) at standard conditions (4 parts per million) being stored in pipe-type or bottle-type holders? (TD.ICP.PIPEBOTTLE.O) 192.475(c)

Training and Qualification - OQ Protocol 9

1. Program Inspection Deficiencies Have potential issues identified by the OQ plan inspection process been corrected at the operational level? (TQ.PROT9.CORRECTION.O) 192.801(a) (192.809(a))

GD.2024.01 Page 73 of 85

2. Covered Task Performance Verify the qualified individuals performed the observed covered tasks in accordance with the operator's procedures or operator approved contractor procedures. (TQ.PROT9.TASKPERFORMANCE.O) 192.801(a) (192.809(a))
3. Qualification Status Verify the individuals performing the observed covered tasks are currently qualified to perform the covered tasks. (TQ.PROT9.QUALIFICATIONSTATUS.O) 192.801(a) (192.809(a))
4. Abnormal Operating Condition Recognition and Reaction <i>Verify the individuals performing covered tasks are cognizant of the AOCs that are applicable to the tasks observed.</i> (TQ.PROT9.AOCRECOG.O) 192.801(a) (192.809(a))
5. Verification of Qualification Observe in the field (job site, local office, etc.) that the foreman/supervisor/manager has verified the qualification of the individual performing the task, that the qualification records are current, and ensure the personal identification of all individuals performing covered tasks are checked, prior to task performance. (TQ.PROT9.VERIFYQUAL.O) 192.801(a) (192.809(a))
Training and Qualification - Operator Qualification
1. Notification of Significant Plan Changes Does the process require significant OQ program changes to be identified and the Administrator or State agency notified? (TQ.OQ.CHANGENOTIFY.P) 192.805(i) (192.18)
2. Records of OQ Program Changes Are records maintained for changes that affect covered tasks and significant OQ plan changes? (TQ.OQ.CHANGERECORD.R) 192.805(i) (192.805(f);192.18)
3. Evaluation Methods Are evaluation methods established and documented appropriate to each covered task? (TQ.OQ.EVALMETHOD.P) 192.805(b) (192.803;192.809(d);192.809(e))
4. Management of Changes Does the OQ program identify how changes to procedures, tools standards and other elements used by individuals in performing covered tasks are communicated to the individuals, including contractor individuals, and how these changes are implemented in the evaluation method(s)? (TQ.OQ.MOC.P) 192.805(f)

GD.2024.01 Page 74 of 85

5. Covered Task Performed by Non-Qualified Individual Are there provisions for non-qualified individuals to perform covered tasks while being directed and observed by a qualified individual, and are there restrictions and limitations place on such activities? (TQ.OQ.NONQUALIFIED.P) 192.805(c)
6. Contractor Qualification Documentation Meets Operator Requirements Does the OQ plan document that the operator has assured that the procedures on which an OQ vendor has evaluated qualified personnel are the same or consistent with those used by the operator for employees and contractors in the field? (TQ.OQ.OQCONTRACTOREQUIV.P) 192.805(h)
7. Operator Qualification Plan and Covered Tasks <i>Do individuals performing covered tasks demonstrate adequate skills, knowledge, and ability?</i> (TQ.OQ.OQPLAN.O) 192.805(h)
8. Operator Qualification Plan and Covered Tasks <i>Is there an OQ plan that includes covered tasks, and the basis used for identifying covered tasks?</i> (TQ.OQ.OQPLAN.P) 192.805(a) (192.801(b))
9. Contractors Adhering to OQ Plan Does the OQ plan have a process to communicate the OQ plan requirements to contractors and ensure that contractors are following it? (TQ.OQ.OQPLANCONTRACTOR.P) 192.805(b) (192.805(f);192.805(c))
10. Personnel Performance Monitoring If the operator had an incident/accident where there is reason to believe that an individual contributed to the cause, do records indicate evaluation of the individual following the occurrence? (TQ.OQ.PERFMONITOR.R) 192.805(d) (192.805(e))
11. Qualification Records for Personnel Performing Covered Tasks Do records document the evaluation and qualifications of individuals performing covered tasks, and can the qualification of individuals performing covered tasks be verified? (TQ.OQ.RECORDS.R) 192.807
12. Training Requirements (Initial, Retraining, and Reevaluation) Does the OQ program provide for initial qualification, retraining and reevaluation of individuals performing covered tasks? (TQ.OQ.TRAINING.P) 192.805(h)
13. Management of Other Entities Performing Covered Tasks Does the OQ plan require other entities that perform covered tasks on behalf of the operator to be qualified? (TQ.OQ.OQCONTRACTOR.P) 192.805(b) (192.805(c);192.805(d);192.805(e);192.805(f))

GD.2024.01 Page 75 of 85

14. Reevaluation Intervals for Covered Tasks Does the OQ plan establish and justify requirements for reevaluation intervals for each covered task? (TQ.OQ.REEVALINTERVAL.P) 192.805(g)
15. Training Requirements (Initial, Retraining, and Reevaluation) Does the operator have records for initial qualification, retraining and reevaluation of individuals performing covered tasks? (TQ.OQ.TRAINING.R) 192.807(a) (192.807(b))
16. Contractor Qualification Are adequate records containing the required elements maintained for contractor personnel? (TQ.OQ.OQCONTRACTOR.R) 192.807(a) (192.807(b))
17. Management of Other Entities Performing Covered Tasks <i>If the operator employs other entities to perform covered tasks, such as mutual assistance, are adequate records containing the required elements maintained?</i> (TQ.OQ.OTHERENTITY.R) 192.805(b) (192.805(c);192.803)
18. Abnormal Operating Conditions Does the OQ Plan contain requirements to assure that individuals performing covered tasks are able to recognize and react to abnormal operating conditions (AOCs)? (TQ.OQ.ABNORMAL.P) 192.803
19. Abnormal Operating Conditions <i>Do records document evaluation of qualified individuals for recognition and reaction to AOCs?</i> (TQ.OQ.ABNORMAL.R) 192.807(a) (192.807(b);192.803)
20. Abnormal Operating Conditions <i>Do individuals performing covered tasks have adequate knowledge to recognize and react to abnormal operating conditions</i> ? (TQ.OQ.ABNORMAL.O) 192.803
21. Personnel Performance Monitoring Does the program include provisions to evaluate an individual if there is reason to believe that performance of a covered task contributed to an incident or accident as defined in Parts 192 and 195 or there is reason to believe an individual is no longer qualified to perform a covered task? (TQ.OQ.PERFMONITOR.P) 192.805(d) (192.805(e))

GD.2024.01 Page 76 of 85

Training and Qualification - Qualification of Personnel - Specific Requirements

1. Corrosion Co	ontrol Personnel (Qualification	Does the process	require corrosio	n control	procedures to	be carried
out by, or under the	e direction of, qualified pe	ersonnel? (TQ.QU	.CORROSION.P) 1	92.453 (192.80	5(b))		

- **2. Corrosion Control Personnel Qualification** *Do records indicate qualification of personnel implementing pipeline corrosion control methods?* (TQ.QU.CORROSION.R) 192.453 (192.807(a);192.807(b))
- **3. Qualification of Personnel Tapping Pipelines under Pressure** *Does the process require taps on a pipeline under pressure (hot taps) to be performed by qualified personnel?* (TQ.QU.HOTTAPQUAL.P) 192.627 (192.805(b))

Training and Qualification - Qualification of Personnel - Specific Requirements (O and M Construction)

- **1. Qualification of Welders** Does the process require welders to be qualified in accordance with API 1104 or the ASME Boiler & Pressure Vessel Code? (TQ.QUOMCONST.WELDER.P) 192.227(a) (192.225(a);192.328(b);192.328(b))
- **2. Qualification of Welders for Low Stress Pipe** Does the process require welders who perform welding on low stress pipe on lines that operate at < 20% SMYS to be qualified under Section I of Appendix C to Part 192, and are welders who perform welding on service line connection to a main required to be qualified under Section II of Appendix C to Part 192? (TQ.QUOMCONST.WELDERLOWSTRESS.P) 192.227(b) (192.225(a);192.225(b);192.805(b))
- **3. Qualification of Welders** *Do records indicate adequate qualification of welders?* (TQ.QUOMCONST.WELDER.R) 192.227(a) (192.227(b);192.229(a);192.229(c);192.229(d);192.328(a);192.328(b);192.328(b);192.807(a);
- **4. Qualification of Nondestructive Testing Personnel** *Do records indicate the qualification of nondestructive testing personnel?* (TQ.QUOMCONST.NDT.R) 192.243(b)(2) (192.807(a);192.807(b);192.328(a);192.328(b))

GD.2024.01 Page 77 of 85

- **5.** Qualification of Personnel Making Joints in Plastic Pipelines Does the process require personnel making joints in plastic pipelines be qualified? (TQ.QUOMCONST.PLASTIC.P) 192.285(a) (192.285(d);192.805(b);192.285(c)) Note: this question is presented in multiple places so you will see multiple instances of it on this report.
- **6. Qualification of Personnel Inspecting Joints in Plastic Pipelines** *Does the process require that persons who inspect joints in plastic pipes be qualified?* (TQ.QUOMCONST.PLASTICINSPECT.P) 192.287 (192.805(b))

 Note: this question is presented in multiple places so you will see multiple instances of it on this report.
- **7. Qualification of Personnel Making Joints in Plastic Pipelines** *Do records indicate adequate qualification of personnel making/inspecting joints in plastic pipelines?* (TQ.QUOMCONST.PLASTIC.R) 192.285(a) (192.285(d);192.287;192.807(a);192.807(b);192.285(c))

Note: this question is presented in multiple places so you will see multiple instances of it on this report.

8. Qualification of Personnel Making Joints in Plastic Pipelines *Do field observations verify personnel making/inspecting joints in plastic pipelines demonstrate adequate skills and knowledge?* (TQ.QUOMCONST.PLASTIC.O) 192.285(a) (192.287;192.803)

Note: this question is presented in multiple places so you will see multiple instances of it on this report.

Section 114 - Section 114 - Gas Distribution

- 1. Scoping Inspection Coverage What are your assets comprised of? (SRN.114.INSPECTCVRG.S)

 Note: this question is presented in multiple places so you will see multiple instances of it on this report.
- **2. Scoping Gas Transportation** Do you transport natural gas as a specific commodity (i.e., not a byproduct or constituent of another substance)? (SRN.114.GASTRANSPORT.S)

Note: this question is presented in multiple places so you will see multiple instances of it on this report.

GD.2024.01 Page 78 of 85

3. Scoping - Driver or Engines Do you use natural gas-fueled drivers or engines to compress natural gas? (SRN.114.DRIVERENGINE.S)

Note: this question is presented in multiple places so you will see multiple instances of it on this report.

4. Scoping - Use of Natural Gas Do you use natural gas for fuel or power appurtenances or instrument gas on regulated facilities? (SRN.114.NGUSE.S)

Note: this question is presented in multiple places so you will see multiple instances of it on this report.

- **5. Leaks & Releases Identification of Fugitive Emissions** Do procedures provide a methodology for identifying sources of fugitive natural gas emissions in the system? (114.114.LKRLSID.P) 49 U.S.C. 60108(a) **Note: this question is presented in multiple places so you will see multiple instances of it on this report.**
- **6. Leaks & Releases Venting** Do procedures identify measures for minimizing natural gas release volumes associated with non-emergency venting and blowdowns from operations and maintenance? (114.114.LKRLSVENT.P) 49 U.S.C. 60108(a) **Note:** this question is presented in multiple places so you will see multiple instances of it on this report.
- **7. Leaks & Releases Investigation of Unanticipated Vented Releases** Do procedures provide for investigation of any unanticipated vented releases of natural gas, and if so, what are the associated actions? (114.114.LKRLSUNEXPCTVENT.P) 49 U.S.C. 60108(a)

Note: this question is presented in multiple places so you will see multiple instances of it on this report.

- **8. Leaks & Releases Leak Data Collection and Analysis** Do procedures include a methodology to collect, retain and analyze detailed information from detected natural gas leaks, including those eliminated by lubrication, adjustment, tightening or otherwise below thresholds for regulatory reporting? (114.114.LKRLSLKDATA.P) 49 U.S.C. 60108(a) **Note: this question is presented in multiple places so you will see multiple instances of it on this report.**
- **9. Leaks & Releases Detecting Leaks** Do procedures include instructions for personnel to detect leaks to help further reduce emission in stations and along the right of way? (114.114.LKRLSDETECTLK.P) 49 U.S.C. 60108(a) **Note:** this question is presented in multiple places so you will see multiple instances of it on this report.

GD.2024.01 Page 79 of 85

10. Leak Mitigation & Repair Do procedures define a process to identify, classify, mitigate and repair leaks? (114.114.LKRLSIDMITRPR.P) 49 U.S.C. 60108(a)

Note: this question is presented in multiple places so you will see multiple instances of it on this report.

11. Leak Mitigation & Repair - Lost & Unaccounted for Gas Do procedures provide for review of Lost & Unaccounted for Gas (LAUF) and do procedures specify actions to reduce the associated volume? (114.114.LKMITRPRLAUF.P) 49 U.S.C. 60108(a)

Note: this question is presented in multiple places so you will see multiple instances of it on this report.

12. Regulator Stations - O&M Do maintenance or operational procedures contain measures for reduction of natural gas releases from regulators? (114.114.REGSTATIONOM.P) 49 U.S.C. 60108(a)

Note: this question is presented in multiple places so you will see multiple instances of it on this report.

13. Regulator Stations - Configuration Do maintenance or operational procedures contain measures for identifying potential configuration changes that would reduce natural gas releases from regulators? (114.114.REGSTATIONCONFIG.P) 49 U.S.C. 60108(a)

Note: this question is presented in multiple places so you will see multiple instances of it on this report.

14. Testing - Relief Valves Do relief valve testing procedures include measures to minimize natural gas releases? (114.114.TESTRELIEFVLV.P) 49 U.S.C. 60108(a)

Note: this question is presented in multiple places so you will see multiple instances of it on this report.

15. Flaring Do procedures for flaring from pipeline facilities for transporting natural gas include measures for minimization of natural gas emissions? (114.114.FLARE.P) 49 U.S.C. 60108(a)

Note: this question is presented in multiple places so you will see multiple instances of it on this report.

16. General - Feedback to Design/Configuration Practices Do operation and maintenance procedures contain mechanisms for identifying potential design/configuration changes for reducing natural gas releases? (114.114.GNLDSGNCNFG.P) 49 U.S.C. 60108(a)

Note: this question is presented in multiple places so you will see multiple instances of it on this report.

GD.2024.01 Page 80 of 85

17. Leak-Prone: Leaks & Releases What procedures are in place to monitor for and identify pipe segments that are leak-prone, and what criteria (e.g., frequency of leak or failure events) are specified for determining a pipeline segment is leak-prone? (114.LEAKPRONE.LKRLS.P) 49 U.S.C. 60108(a)

Note: this question is presented in multiple places so you will see multiple instances of it on this report.

18. Leak-Prone: Leaks & Releases - Leak Data Collection and Analysis Do procedures include a methodology to collect, retain and analyze detailed information from detected leaks, including those eliminated by lubrication, adjustment, tightening or otherwise below thresholds for regulatory reporting? (114.LEAKPRONE.LKRLSLKDATA.P) 49 U.S.C. 60108(a)

Note: this question is presented in multiple places so you will see multiple instances of it on this report.

19. Leak-Prone: Leaks Mitigation & Repair - Replacement and Remediation (Example Section 114 Materials) Do procedures identify cast iron, unprotected steel, wrought iron, and vintage plastic pipe with known leak issues? (114.LEAKPRONE.LKMITGRPREXAMPLE.P) 49 U.S.C. 60108(a)

Note: this question is presented in multiple places so you will see multiple instances of it on this report.

20. Leak-Prone: Leak Mitigation & Repair - Replacement and Remediation (Other Materials) Do procedures clearly define a process to address replacement or remediation of pipe segments with known leak issues beyond those specifically identified in Section 114? (114.LEAKPRONE.LKMITGRPROTHER.P) 49 U.S.C. 60108(a)

Note: this question is presented in multiple places so you will see multiple instances of it on this report.

Section 114 - Section 114 - Master Meter

- 1. Scoping Inspection Coverage What are your assets comprised of? (SRN.114.INSPECTCVRG.S)

 Note: this question is presented in multiple places so you will see multiple instances of it on this report.
- **2. Scoping Gas Transportation** Do you transport natural gas as a specific commodity (i.e., not a byproduct or constituent of another substance)? (SRN.114.GASTRANSPORT.S)

Note: this question is presented in multiple places so you will see multiple instances of it on this report.

GD.2024.01 Page 81 of 85

3. Scoping - Driver or Engines Do you use natural gas-fueled drivers or engines to compress natural gas? (SRN.114.DRIVERENGINE.S)

Note: this question is presented in multiple places so you will see multiple instances of it on this report.

4. Scoping - Use of Natural Gas *Do you use natural gas for fuel or power appurtenances or instrument gas on regulated facilities?* (SRN.114.NGUSE.S)

Note: this question is presented in multiple places so you will see multiple instances of it on this report.

- **5. Leaks & Releases Identification of Fugitive Emissions** Do procedures provide a methodology for identifying sources of fugitive natural gas emissions in the system? (114.114.LKRLSID.P) 49 U.S.C. 60108(a) **Note: this question is presented in multiple places so you will see multiple instances of it on this report.**
- **6. Leaks & Releases Venting** Do procedures identify measures for minimizing natural gas release volumes associated with non-emergency venting and blowdowns from operations and maintenance? (114.114.LKRLSVENT.P) 49 U.S.C. 60108(a) **Note:** this question is presented in multiple places so you will see multiple instances of it on this report.
- **7. Leaks & Releases Investigation of Unanticipated Vented Releases** Do procedures provide for investigation of any unanticipated vented releases of natural gas, and if so, what are the associated actions? (114.114.LKRLSUNEXPCTVENT.P) 49 U.S.C. 60108(a)

Note: this question is presented in multiple places so you will see multiple instances of it on this report.

- **8. Leaks & Releases Leak Data Collection and Analysis** Do procedures include a methodology to collect, retain and analyze detailed information from detected natural gas leaks, including those eliminated by lubrication, adjustment, tightening or otherwise below thresholds for regulatory reporting? (114.114.LKRLSLKDATA.P) 49 U.S.C. 60108(a) **Note: this question is presented in multiple places so you will see multiple instances of it on this report.**
- **9. Leaks & Releases Detecting Leaks** Do procedures include instructions for personnel to detect leaks to help further reduce emission in stations and along the right of way? (114.114.LKRLSDETECTLK.P) 49 U.S.C. 60108(a)

 Note: this question is presented in multiple places so you will see multiple instances of it on this report.

GD.2024.01 Page 82 of 85

10. Leak Mitigation & Repair Do procedures define a process to identify, classify, mitigate and repair leaks? (114.114.LKRLSIDMITRPR.P) 49 U.S.C. 60108(a)

Note: this question is presented in multiple places so you will see multiple instances of it on this report.

11. Leak Mitigation & Repair - Lost & Unaccounted for Gas Do procedures provide for review of Lost & Unaccounted for Gas (LAUF) and do procedures specify actions to reduce the associated volume? (114.114.LKMITRPRLAUF.P) 49 U.S.C. 60108(a)

Note: this question is presented in multiple places so you will see multiple instances of it on this report.

12. Regulator Stations - O&M Do maintenance or operational procedures contain measures for reduction of natural gas releases from regulators? (114.114.REGSTATIONOM.P) 49 U.S.C. 60108(a)

Note: this question is presented in multiple places so you will see multiple instances of it on this report.

13. Regulator Stations - Configuration Do maintenance or operational procedures contain measures for identifying potential configuration changes that would reduce natural gas releases from regulators? (114.114.REGSTATIONCONFIG.P) 49 U.S.C. 60108(a)

Note: this question is presented in multiple places so you will see multiple instances of it on this report.

14. Testing - Relief Valves Do relief valve testing procedures include measures to minimize natural gas releases? (114.114.TESTRELIEFVLV.P) 49 U.S.C. 60108(a)

Note: this question is presented in multiple places so you will see multiple instances of it on this report.

15. Flaring Do procedures for flaring from pipeline facilities for transporting natural gas include measures for minimization of natural gas emissions? (114.114.FLARE.P) 49 U.S.C. 60108(a)

Note: this question is presented in multiple places so you will see multiple instances of it on this report.

16. General - Feedback to Design/Configuration Practices *Do operation and maintenance procedures contain mechanisms for identifying potential design/configuration changes for reducing natural gas releases?* (114.114.GNLDSGNCNFG.P) 49 U.S.C. 60108(a)

Note: this question is presented in multiple places so you will see multiple instances of it on this report.

GD.2024.01 Page 83 of 85

17. Leak-Prone: Leaks & Releases What procedures are in place to monitor for and identify pipe segments that are leak-prone, and what criteria (e.g., frequency of leak or failure events) are specified for determining a pipeline segment is leak-prone? (114.LEAKPRONE.LKRLS.P) 49 U.S.C. 60108(a)

Note: this question is presented in multiple places so you will see multiple instances of it on this report.

18. Leak-Prone: Leaks & Releases - Leak Data Collection and Analysis Do procedures include a methodology to collect, retain and analyze detailed information from detected leaks, including those eliminated by lubrication, adjustment, tightening or otherwise below thresholds for regulatory reporting? (114.LEAKPRONE.LKRLSLKDATA.P) 49 U.S.C. 60108(a)

Note: this question is presented in multiple places so you will see multiple instances of it on this report.

19. Leak-Prone: Leaks Mitigation & Repair - Replacement and Remediation (Example Section 114 Materials) Do procedures identify cast iron, unprotected steel, wrought iron, and vintage plastic pipe with known leak issues? (114.LEAKPRONE.LKMITGRPREXAMPLE.P) 49 U.S.C. 60108(a)

Note: this question is presented in multiple places so you will see multiple instances of it on this report.

20. Leak-Prone: Leak Mitigation & Repair - Replacement and Remediation (Other Materials) Do procedures clearly define a process to address replacement or remediation of pipe segments with known leak issues beyond those specifically identified in Section 114? (114.LEAKPRONE.LKMITGRPROTHER.P) 49 U.S.C. 60108(a)

Note: this question is presented in multiple places so you will see multiple instances of it on this report.

Generic Questions - Generic Questions - Special Permits

- **1. Generic Question Special Permit** *Generic question please provide context in result notes.* (GENERIC.GENERICSP.GENOBSERVE.O)
- **2. Generic Question Special Permit** *Generic question please provide context in result notes.* (GENERIC.GENERICSP.GENPROCEDURE.P)

GD.2024.01 Page 84 of 85

3. Generic Question - Special Pe	rmit Generic question - please provide context in result notes.
(GENERIC.GENERICSP.GENRECORD.R)	

Generic Questions - Generic Questions

- 1. Generic Question Generic question please provide context in result notes. (GENERIC.GENERIC.GENOBSERVE.O)
- 2. Generic Question Generic question please provide context in result notes. (GENERIC.GENERIC.GENPROCEDURE.P)
- **3. Generic Question** Generic question please provide context in result notes. (GENERIC.GENERIC.GENRECORD.R)

Except as required to be disclosed by law, any inspection documentation, including completed protocol forms, summary reports, executive summary reports, and enforcement documentation are for internal use only by federal or state pipeline safety regulators. Some inspection documentation may contain information which the operator considers to be confidential. In addition, supplemental inspection guidance and related documents in the file library are also for internal use only by federal or state pipeline safety regulators (with the exception of documents published in the federal register, such as advisory bulletins). Do not distribute or otherwise disclose such material outside of the state or federal pipeline regulatory organizations. Requests for such information from other government organizations (including, but not limited to, NTSB, GAO, IG, or Congressional Staff) should be referred to PHMSA Headquarters Management.

GD.2024.01 Page 85 of 85